

VA




U.S. Department of Veterans Affairs

Office of Construction & Facilities Management

Office of Facilities Planning

Facilities Standards Service

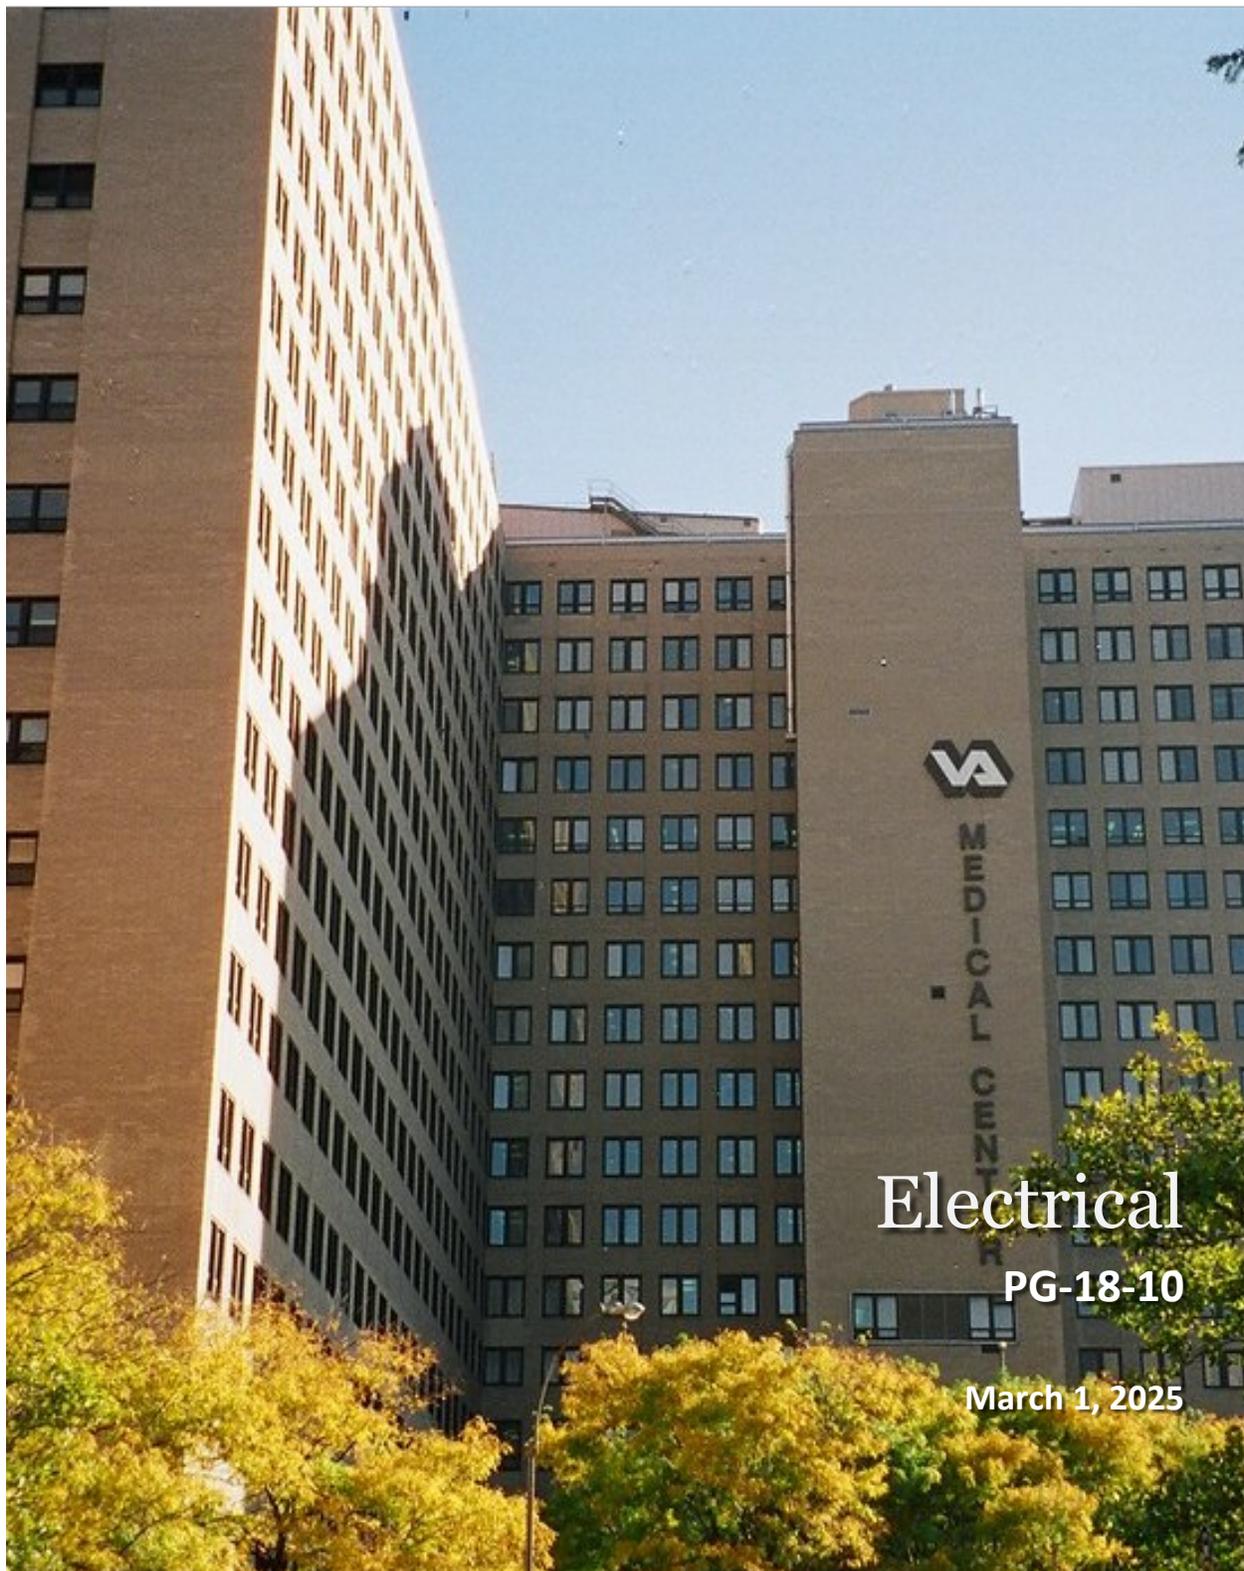

Electrical

PG-18-10

March 1, 2025

designmanual

TABLE OF CONTENTS

CHAPTER 1: GENERAL REQUIREMENTS 1-1

 1.1 PURPOSE 1-5

 1.2 RESPONSIBILITY 1-6

 1.3 AUTHORITY HAVING JURISDICTION 1-6

 1.4 COORDINATION 1-6

 1.5 VA DESIGN CRITERIA 1-7

 1.5.1 MASTER SPECIFICATIONS (PG-18-1) 1-7

 1.5.2 DESIGN AND CONSTRUCTION PROCEDURES (PG-18-3, Topics 1 - 18) 1-7

 1.5.3 NATIONAL CAD STANDARD, VHA APPLICATION GUIDE & STANDARD DETAILS
 (PG-18-4) 1-8

 1.5.4 EQUIPMENT GUIDE LIST (PG-18-5) 1-8

 1.5.5 DESIGN MANUALS (PG-18-10) 1-8

 1.5.6 DESIGN GUIDES (PG-18-12) 1-9

 1.5.7 DESIGN SUBMISSION INSTRUCTIONS (PG-18-15) 1-9

 1.5.8 DESIGN REVIEW CHECKLISTS 1-10

 1.5.9 DESIGN ALERTS 1-10

 1.5.10 STANDARDS ALERTS 1-10

 1.5.11 PHYSICAL SECURITY AND RESILIENCY DESIGN MANUAL 1-10

 1.5.12 COST ESTIMATING MANUAL 1-11

 1.5.13 SUSTAINABLE DESIGN MANUAL 1-11

 1.5.14 SEISMIC DESIGN REQUIREMENTS (H-18-8) 1-11

 1.5.15 FIRE PROTECTION DESIGN MANUAL 1-11

 1.5.16 VA HOSPITAL BUILDING SYSTEM 1-12

 1.5.17 COMPUTER AIDED FACILITIES MANAGEMENT REQUIREMENTS (CAFM) 1-12

 1.6 VA BIM STANDARD 1-12

 1.7 APPLICABLE CODES AND STANDARDS 1-12

 1.7.1 GENERAL 1-12

 1.7.2 LOCAL CODES AND CONDITIONS 1-13

 1.7.3 LOCAL UTILITY 1-14

 1.8 DESIGN REQUIREMENTS 1-14

 1.9 CRITERIA UNIQUE TO VA 1-15

 1.9.1 DRAWINGS 1-15

 1.9.2 SEQUENCE OF ELECTRICAL DRAWINGS 1-16

 1.9.3 ABBREVIATIONS AND SYMBOLS 1-16

 1.9.4 PROPRIETARY ITEMS 1-16

 1.10 CALCULATIONS 1-17



- 1.10.1 GENERAL.....1-17
- 1.10.2 FAULT CURRENT CALCULATIONS 1-18
- 1.10.3 PROTECTIVE DEVICE COORDINATION CALCULATIONS 1-18
- 1.10.4 ARC FLASH CALCULATIONS..... 1-19
- 1.10.5 LOAD CALCULATIONS 1-19
- 1.10.6 GENERATOR SIZING CALCULATIONS..... 1-20
- 1.10.7 VOLTAGE DROP CALCULATIONS 1-20
- 1.10.8 HARMONIC DISTORTION CALCULATIONS 1-20
- 1.10.9 LIGHTNING PROTECTION CALCULATIONS..... 1-20
- 1.11 SEISMIC BRACING 1-20
- 1.11.1 REFERENCES 1-20
- 1.11.2 DRAWINGS 1-21
- 1.11.3 EQUIPMENT BRACING 1-21
- 1.12 TRANSPORT SYSTEMS..... 1-21
- 1.13 FIRE ALARM SYSTEMS..... 1-21
- 1.14 RENOVATION TO EXISTING SITES AND BUILDINGS 1-21
- 1.14.1 DRAWINGS 1-21
- 1.14.2 MODIFICATION VERSUS REPLACEMENT 1-21
- 1.14.3 AGE AND PHYSICAL CONDITION 1-22
- 1.14.4 PARTS AVAILABILITY 1-22
- 1.14.5 CONDUIT AND BOXES..... 1-22
- 1.14.6 CONDUCTORS..... 1-22
- 1.14.7 WIRING DEVICES..... 1-22
- 1.14.8 LIGHTING FIXTURES 1-23
- 1.14.9 PANELBOARDS..... 1-23
- 1.14.10 GOVERNMENT RETAINED EQUIPMENT 1-23
- 1.14.11 CONTINUITY OF SERVICE 1-24
- 1.14.12 COMPATIBILITY..... 1-24
- CHAPTER 2: RACEWAYS, WIRING, AND EQUIPMENT 2-1
- 2.1 RACEWAYS..... 2-3
- 2.1.1 CONCEALED AND EXPOSED 2-3
- 2.1.2 UNDERGROUND DUCTS AND CONDUITS..... 2-3
- 2.1.3 SPARE CONDUITS..... 2-3
- 2.1.4 UNDERFLOOR DUCT SYSTEMS 2-3
- 2.1.5 IMAGING ROOMS 2-4
- 2.1.6 POKE-THRU/POWER POLES 2-5
- 2.1.7 ETHYLENE OXIDE STERILIZATION AREA 2-5
- 2.2 GROUNDING..... 2-5



- 2.2.1 GROUNDING ELECTRODES.....2-5
- 2.2.2 EQUIPMENT GROUNDING CONDUCTORS.....2-5
- 2.2.3 METAL CURTAIN WALL GROUNDING2-5
- 2.3 LIGHTNING PROTECTION SYSTEM2-6
- 2.4 MOTOR DISCONNECT SWITCHES.....2-6
- CHAPTER 3: RECEPTACLE AND POWER REQUIREMENTS.....3-1
- 3.1 GENERAL.....3-3
- 3.2 ESSENTIAL ELECTRICAL SYSTEM CIRCUITS3-3
- 3.3 RECEPTACLE CIRCUITS3-3
- 3.4 SPECIFIC APPLICATIONS.....3-3
- 3.4.1 GROUND-FAULT CIRCUIT INTERRUPTER (GFCI) RECEPTACLES.....3-3
- 3.4.2 SURGICAL/OPERATING ROOMS.....3-3
- 3.4.3 ICU-CCU FOOT-WALL RECEPTACLES3-4
- 3.4.4 EXTERIOR ELECTRICAL RECEPTACLES.....3-4
- 3.4.5 WAITING, LOUNGE AND LOBBY AREAS.....3-5
- 3.4.6 ANIMAL SURGERY ROOMS (RESEARCH)3-5
- 3.4.7 SELF-ILLUMINATED EMERGENCY RECEPTACLES3-5
- 3.4.8 CORRIDORS.....3-5
- 3.4.9 KITCHENS.....3-5
- 3.4.10 OFFICES AND ADMINISTRATIVE AREAS3-6
- 3.4.11 LABORATORIES AND RESEARCH FACILITIES3-6
- 3.4.12 PHYSICAL MEDICINE AND REHABILITATION SERVICE3-6
- 3.4.13 PSYCHIATRIC PATIENT ROOMS3-6
- 3.4.14 STAIRWELLS.....3-6
- 3.4.15 INTERSTITIAL SPACES.....3-7
- 3.4.16 TV/CCTV POWER RECEPTACLES.....3-7
- 3.4.17 ELECTRICAL CLOSETS3-7
- 3.4.18 MOTORIZED TREADMILLS.....3-7
- CHAPTER 4: ESSENTIAL AND STANDBY ELECTRICAL POWER SYSTEMS.....4-1
- 4.1 GENERAL.....4-3
- 4.2 MIXED ESSENTIAL AND STANDBY ELECTRICAL POWER SYSTEMS4-3
- 4.3 COMMISSIONING4-3
- 4.4 EQUIPMENT AND RATINGS.....4-3
- 4.4.1 GENERATORS.....4-3
- 4.4.2 AUTOMATIC TRANSFER SWITCHES (ATS).....4-4
- 4.4.3 CONTROL NETWORK4-4
- 4.4.4 DIESEL FUEL STORAGE4-4
- 4.4.5 LOCATION.....4-4



4.5 EXISTING FACILITIES 4-5

4.6 ESSENTIAL ELECTRICAL SYSTEMS FOR HOSPITALS 4-5

4.6.1 ENFORCING CODES..... 4-5

4.6.1.1 Life Safety Branch 4-5

4.6.1.2 Critical Branch 4-6

4.6.1.3 Equipment Branch Delayed-Automatic Connection 4-8

4.6.2 (Reserved) 4-10

4.6.3 ALTERNATE SOURCE OF POWER..... 4-10

4.7 ESSENTIAL ELECTRICAL SYSTEM FOR NURSING HOMES AND LIMITED CARE FACILITIES 4-10

4.7.1 LIFE SAFETY BRANCH 4-11

4.7.2 CRITICAL BRANCH 4-11

4.7.3 ALTERNATE SOURCE OF POWER..... 4-11

4.8 ESSENTIAL ELECTRICAL SYSTEM FOR OTHER HEALTHCARE FACILITIES 4-11

4.8.1 ALTERNATE SOURCE OF POWER..... 4-11

4.9 ESSENTIAL ELECTRICAL SYSTEM FOR OTHER FACILITIES 4-12

4.9.1 BOILER PLANT AND ENERGY CENTER 4-12

4.9.2 FIRE STATION..... 4-12

4.10 STANDBY ELECTRICAL SYSTEM 4-12

4.10.1 REQUIREMENTS..... 4-12

4.10.2 SOURCE OF POWER 4-13

CHAPTER 5: ELECTRICAL POWER DISTRIBUTION 5-1

5.1 UTILITY SERVICE..... 5-3

5.2 PRIMARY DISTRIBUTION 5-3

5.2.1 GENERAL..... 5-3

5.2.2 PRIMARY SWITCHGEAR 5-3

5.2.3 PRIMARY CABLING..... 5-4

5.2.4 SUBSTATION PRIMARY-VOLTAGE DISCONNECTING MEANS 5-4

5.3 SECONDARY DISTRIBUTION 5-4

5.3.1 GENERAL..... 5-4

5.3.2 MEDIUM-TO-LOW VOLTAGE TRANSFORMERS 5-4

5.3.3 LOW VOLTAGE TRANSFORMERS 5-4

5.3.4 SWITCHGEAR, SWITCHBOARDS, AND MOTOR CONTROL CENTERS..... 5-5

5.3.5 BRANCH-CIRCUIT PANELBOARDS 5-5

5.3.6 TYPE 2 SURGE-PROTECTIVE DEVICES (TYPE 2 SPD)..... 5-5

5.3.7 LOADS FED FROM UNINTERRUPTIBLE POWER SUPPLY (UPS)..... 5-5

5.4 POWER MONITORING AND METERING 5-5

5.4.1 GENERAL..... 5-5



- 5.4.2 ENERGY CENTERS5-6
- 5.4.3 EXISTING FACILITIES5-6
- 5.5 ELECTRICAL ROOMS AND CLOSETS.....5-6
- 5.5.1 GENERAL.....5-6
- 5.5.2 SPACE FOR FUTURE EQUIPMENT.....5-7
- 5.6 ELECTRICAL FACILITIES FOR SURGICAL/OPERATING ROOMS.....5-7
- 5.7 ELECTRICAL FACILITIES FOR ELEVATORS.....5-7
- CHAPTER 6: SPECIAL MEDICAL AND ALARM SYSTEMS6-1
- 6.1 GENERAL.....6-3
- 6.2 PATIENT BED SERVICE WALL SYSTEMS6-3
- 6.3 PATIENT BED SERVICE WALLS (PBSW)6-3
- 6.4 PBSW INSTALLATION6-3
- 6.5 PBSW APPLICATION.....6-3
- 6.6 MEDICAL GAS, VACUUM, AND AIR ALARM SYSTEMS6-4



CHAPTER 1: GENERAL REQUIREMENTS

1.1 PURPOSE 1-5

1.2 RESPONSIBILITY 1-6

1.3 AUTHORITY HAVING JURISDICTION 1-6

1.4 COORDINATION 1-6

1.5 VA DESIGN CRITERIA..... 1-7

1.5.1 MASTER SPECIFICATIONS (PG-18-1) 1-7

1.5.2 DESIGN AND CONSTRUCTION PROCEDURES (PG-18-3) 1-7

1.5.3 NATIONAL CAD STANDARD, VHA APPLICATION GUIDE & STANDARD DETAILS
(PG-18-4) 1-8

1.5.4 EQUIPMENT GUIDE LIST (PG-18-5) 1-8

1.5.5 DESIGN MANUALS (PG-18-10) 1-8

1.5.6 DESIGN GUIDES (PG-18-12) 1-9

1.5.7 DESIGN SUBMISSION INSTRUCTIONS (PG-18-15) 1-9

1.5.8 DESIGN REVIEW CHECKLISTS 1-10

1.5.9 DESIGN ALERTS..... 1-10

1.5.10 STANDARDS ALERTS 1-10

1.5.11 PHYSICAL SECURITY DESIGN MANUAL..... 1-10

1.5.12 COST ESTIMATING MANUAL 1-11

1.5.13 SUSTAINABLE DESIGN MANUAL 1-11

1.5.14 SEISMIC DESIGN REQUIREMENTS (H-18-8)..... 1-11

1.5.15 FIRE PROTECTION DESIGN MANUAL 1-11

1.5.16 VA HOSPITAL BUILDING SYSTEM 1-12

1.5.17 COMPUTER AIDED FACILITIES MANAGEMENT REQUIREMENTS (CAFM)..... 1-12

1.6 VA BIM STANDARD 1-12

1.7 APPLICABLE CODES AND STANDARDS 1-12

1.7.1 GENERAL 1-12

1.7.2 LOCAL CODES AND CONDITIONS 1-13

1.7.3 LOCAL UTILITY 1-14

1.8 DESIGN REQUIREMENTS..... 1-14

1.9 CRITERIA UNIQUE TO VA 1-15



1.9.1 DRAWINGS 1-15

1.9.2 SEQUENCE OF ELECTRICAL DRAWINGS 1-16

1.9.3 ABBREVIATIONS AND SYMBOLS 1-16

1.9.4 PROPRIETARY ITEMS 1-16

1.10 CALCULATIONS 1-17

1.10.1 GENERAL 1-17

1.10.2 FAULT CURRENT CALCULATIONS..... 1-18

1.10.3 PROTECTIVE DEVICE COORDINATION CALCULATIONS 1-18

1.10.4 ARC FLASH CALCULATIONS..... 1-19

1.10.5 LOAD CALCULATIONS 1-19

1.10.6 GENERATOR SIZING CALCULATIONS..... 1-20

1.10.7 VOLTAGE DROP CALCULATIONS 1-20

1.10.8 HARMONIC DISTORTION CALCULATIONS..... 1-20

1.10.9 LIGHTNING PROTECTION CALCULATIONS..... 1-20

1.11 SEISMIC BRACING 1-20

1.11.1 REFERENCES 1-20

1.11.2 DRAWINGS 1-21

1.11.3 EQUIPMENT BRACING 1-21

1.12 TRANSPORT SYSTEMS..... 1-21

1.13 FIRE ALARM SYSTEMS..... 1-21

1.14 RENOVATION TO EXISTING SITES AND BUILDINGS 1-21

1.14.1 DRAWINGS 1-21

1.14.2 MODIFICATION VERSUS REPLACEMENT 1-21

1.14.3 AGE AND PHYSICAL CONDITION 1-22

1.14.4 PARTS AVAILABILITY 1-22

1.14.5 CONDUIT AND BOXES..... 1-22

1.14.6 CONDUCTORS..... 1-22

1.14.7 WIRING DEVICES 1-22

1.14.8 LIGHTING FIXTURES..... 1-23

1.14.9 PANELBOARDS..... 1-23

1.14.10 GOVERNMENT RETAINED EQUIPMENT 1-23



1.14.11 CONTINUITY OF SERVICE 1-24

1.14.12 COMPATIBILITY..... 1-24



1.1 PURPOSE

This manual is intended as a guide for electrical engineers and designers (hereafter referred to as the A/E) for the planning and design of the electrical power distribution and related systems (hereinafter referred to as systems) at Department of Veterans Affairs (VA) facilities which are designed and constructed with VA construction budget, as well as owned, operated and maintained by VA.

VA requires the A/E to read, understand, and use this manual in the planning and design of the systems in VA owned construction projects – major, minor and non-recurring-maintenance (NRM). VA requires that planning and design work shall comply with this design manual.

The Authority Having Jurisdiction (AHJ) shall be the final authority to evaluate and adjudicate the interpretations or definitions of any requirements in this design manual in accordance with 38 USC 312A. In case where the A/E's interpretations or definitions of any requirements in this design manual are different than the AHJ or his/her designee, the AHJ's decision on the interpretations or definitions of any requirements in this design manual shall be final.

To provide the latitude needed to incorporate new technologies and concepts, or to accommodate adverse existing construction conditions, technical deviations from the stipulations of this manual may be made. Deviation request(s) may be made only if a safe, reliable, and energy-efficient design shall result. Such deviation request(s) must be approved by VA's Contracting Officer (CO) and Authority Having Jurisdiction (AHJ). The A/E, Contracting Officer Representative (COR), and Chief Engineer of Facility Management Services (FMS) shall submit deviation request(s) in writing to the Authority Having Jurisdiction (AHJ). VA's Project Manager (PM) and Veterans Health Administration (VHA) may require specific web-based procedure for this deviation request action; therefore, the A/E, COR, and Chief Engineer of FMS shall confirm specific procedure to submit deviation request(s) with CO, and VHA Healthcare Engineering Office (19HEFP).

At the minimum, request for deviation(s) shall contain the following elements:

- Narrative detailing reasons for the deviations
- Narrative detailing the design and technical information relating to the deviations
- Statement affirming that deviations shall comply with all public laws, federal regulations, executive orders, and latest applicable codes
- Design drawings of the deviations (if applicable)
- Engineering calculations (if applicable)
- Estimate of cost impact caused by the deviations
- Estimate of schedule impact caused by the deviations
- Supporting documents such as existing site survey photographs, drawings and documents (if applicable)



Deviation request(s) shall be considered approved only after the requester has received the written approval with signature from CO and AHJ.

1.2 RESPONSIBILITY

The A/E shall provide all necessary professional services to perform planning and design of the systems for the project. The A/E shall be responsible and liable for the professional design in accordance with the contract, safe and practical engineering practices, applicable VA design criteria, VA project-specific requirements (if any), and latest applicable codes. The A/E shall be responsible and liable for the content of the construction contract document.

1.3 AUTHORITY HAVING JURISDICTION

In accordance with Title 38 USC 312A, the Authority Having Jurisdiction (AHJ) for planning, design, and construction (PDC) of facilities for the Department of Veterans Affairs (VA), including determining architectural and engineering requirements and ensuring compliance of the Department with applicable laws relating to the construction program of the Department, is the Executive Director (ED) of the Office of Construction and Facilities Management (CFM). This authority includes the delegation of authority to the Administrations for their projects. The VA/VHA project manager, project engineer, or COR must obtain AHJ identification, contact information and the process and procedures for compliance reviews, evaluations, and adjudications no later than initiation of the contract.

1.4 COORDINATION

(a) The A/E shall coordinate planning and design work with all disciplines such as architectural, structural, civil, site utility & site work, telecommunications / data, HVAC, plumbing, medical air, fire protection / alarm system, and LEED/Sustainable designs, as applicable. The A/E shall carefully focus on concealed and underground construction areas, and site utility coordination. The A/E shall coordinate and provide electrical design for all electrically operated equipment shown on other disciplines' drawings. For example, the A/E shall provide adjustable frequency drives for motors as required on the mechanical drawings; provide branch circuit power to terminal units, terminal unit fans, smoke dampers, control panels and other auxiliaries; and provide branch circuit power to medical gas alarm panels.

(b) Utility Coordination:

- (1)** For projects requiring new electrical service, the A/E shall coordinate requirements with the local utility service company. The Contractor's scope of work, as it relates to the service, shall be detailed in the Construction Documents. The A/E shall forward copies of all correspondence and minutes of meetings with the utility company's representatives to CO, PM and COR regarding negotiations for new services or making changes to the existing services.
- (2)** For renovations of and/or additions to existing buildings, the A/E shall investigate and confirm the existing electrical service/distribution system. The A/E shall determine whether existing electrical power capacity is available to accommodate new loads. If



applicable, the A/E shall inform the electric utility company of the new service requirements and additional loads.

- (3) The A/E shall show on civil utility drawings, for coordination purposes, all -major site electrical power distribution components, such as medium voltage and low voltage electrical power feeders, ductbanks, and manholes.

(c) Pre-Design Site Survey: For renovation projects, the A/E shall perform the following tasks:

- (1) **Electrical Load Monitoring:** Investigate the existing electrical service/distribution system and determine whether existing electrical power capacity is available to accommodate the new loads. Determining of existing loads shall be as required by the NFPA 70 - National Electrical Code (NEC).
- (2) **Existing Electrical Installation:** Investigate and record all existing field electrical installations such as existing underground ductbanks, manholes, concealed conduit runs, conduit types/sizes, cable types/sizes, panelboard types/sizes, electrical equipment locations, etc., which potentially impact the new design and installation.

1.5 VA DESIGN CRITERIA

The A/E shall use and comply with latest pertinent VA standards posted on the VA's Office of Construction and Facilities Management Technical Information Library (TIL). Some of the major standards are:

1.5.1 MASTER SPECIFICATIONS (PG-18-1)

Located in [Technical Information Library](https://www.cfm.va.gov/TIL/spec.asp) at <https://www.cfm.va.gov/TIL/spec.asp>

Purpose

To provide a detailed description of the quality, standards, products, and execution of work ensuring that products and installation of systems shall meet design in terms of safety, performance, quality, and cost.

The Specifications accomplish this by:

- Providing specific narrative descriptions of required equipment, salient elements, and system construction
- Listing applicable standards and codes and references
- Requiring individual submittal of equipment and systems for review and approval prior to contractor purchase
- Defining specific installation methods to be used

1.5.2 DESIGN AND CONSTRUCTION PROCEDURES (PG-18-3, Topics 1 - 18)

Located in [Technical Information Library](https://www.cfm.va.gov/TIL/cPro.asp) at <https://www.cfm.va.gov/TIL/cPro.asp>.



Purpose

To establish minimum consistent design/construction practices for construction projects at VA facilities. There are 18 topics in the PG-18-3. Topic 8 – Electrical Rooms and Closets - focuses specifically on the electrical rooms and closets requirements.

The Procedures accomplish this by:

- Referencing applicable codes and policies
- Describing standard drawing formats
- Describing electrical rooms and closets sizes and layouts requirements
- Describing physical security and resiliency strategies
- Including miscellaneous design details

1.5.3 NATIONAL CAD STANDARD, VHA APPLICATION GUIDE & STANDARD DETAILS (PG-18-4)

Located in [Technical Information Library](https://www.cfm.va.gov/TIL/sDetail.asp) at <https://www.cfm.va.gov/TIL/sDetail.asp>.

Purpose

To provide VA-specific design abbreviations and symbols, utility and sheet template files, and standard construction details. This PG-18-4 is organized by discipline, and used in the design and developing of construction documents for VA projects.

1.5.4 EQUIPMENT GUIDE LIST (PG-18-5)

Located in [Technical Information Library](https://www.cfm.va.gov/TIL/equip.asp) at <https://www.cfm.va.gov/TIL/equip.asp>.

Purpose

To provide information for planning and developing requirements for contractor purchased and installed equipment.

1.5.5 DESIGN MANUALS (PG-18-10)

Located in [Technical Information Library](https://www.cfm.va.gov/til/dManual.asp) at <https://www.cfm.va.gov/til/dManual.asp>.

Purpose

To convey the general and specific VA design philosophy for medical and support facilities.

The Manuals accomplish this by:

- Explaining specific design methodologies
- Listing acceptable system types
- Setting the overall energy consumption target
- Codifying certain code interpretations



- Listing values for design parameters
- Referencing certain sections of the Master Specification and Standard Details
- Containing examples of certain design elements

Note: The A/E shall submit to CO, PM and COR a list of Design Manuals, with each Design Manual's TIL posted date, on the date of design contract award. This action confirms and affirms to VA that the design shall comply with the requirements stated in each submitted Design Manual with TIL posted date.

1.5.6 DESIGN GUIDES (PG-18-12)

Located in [Technical Information Library](https://www.cfm.va.gov/til/dGuide.asp) at <https://www.cfm.va.gov/til/dGuide.asp>.

Purpose

To provide specific layout templates and medical equipment lists for all types of spaces/uses, and specific design parameters for all designed systems such as structural, electrical, plumbing, and mechanical system.

The Design Guides accomplish this by:

- Publishing design narrative
- Including functional diagrams and layout plates
- Listing standards

1.5.7 DESIGN SUBMISSION INSTRUCTIONS (PG-18-15)

Located in [Technical Information Library](https://www.cfm.va.gov/til/aeDesSubReq.asp) at <https://www.cfm.va.gov/til/aeDesSubReq.asp>.

Purpose

To provide a staged listing of tasks in various design categories, and to ensure thorough and timely completion of the final design package and bid documents.

The Instructions accomplish this by:

- Progressively listing tasks as Schematic, Design Development, and Construction Documents stages
- Requiring task completion and submission for each stage according to a Critical Path Method (CPM) calendar
- Implementation of a QA/QC process to ensure a quality design product
- Requiring life-cycle analysis of alternatives in order to optimize the design/cost tradeoff
- Listing and detailing all the drawings, calculations, and specifications required for a complete design package
- Indicating the final distribution of bid documents



1.5.8 DESIGN REVIEW CHECKLISTS

Located in [Technical Information Library](#) at <https://www.cfm.va.gov/til/aeDesSubReq.asp>.

Purpose

To provide the VA Peer Reviewer, CO, PM and COR with a minimum list of critical items, which must be included in each A/E submission.

The Checklist accomplishes this by:

- Referring to all applicable VA design tools which apply to the specific project
- Detailing certain Life Safety and coordination requirements

1.5.9 DESIGN ALERTS

Located in [Technical Information Library](#) at <https://www.cfm.va.gov/til/alert.asp>.

Purpose

To provide emerging design issues, causes of the issues, impacts to the design, and solutions to mitigate the issues.

The Design Alerts accomplish this by:

- Publishing periodic alert memos
- Summarizing design solutions

1.5.10 STANDARDS ALERTS

Located in [Technical Information Library](#) at <https://www.cfm.va.gov/til/alert.asp>.

Purpose

To identify innovative and broad ranging Standards and Design processes and procedures that have a major impact on the VA's goal of delivering world-class facilities

The Standards Alerts accomplish this by:

- Publishing alerts with focus on specific procedure and innovation.

1.5.11 PHYSICAL SECURITY AND RESILIENCY DESIGN MANUAL

Located in [Technical Information Library](#) at <https://www.cfm.va.gov/til/dManual.asp#PSR>

Purpose

To establish physical security and resiliency standards for facilities that VA requires to continue operation during a natural or man-made extreme event.

VA Physical Security and Resiliency Design Manual (PSRDM) has classified different facility criticality designations based on each facility's function. The A/E shall confirm the criticality designation of each facility in the scope of the design with CO and COR before proceeding with the planning or design work.



The Manual accomplishes this by:

- Setting objectives for physical security and resiliency
- Providing strategies for use in design and construction to provide protection to VA facilities
- Providing cost-effective design criteria

1.5.12 COST ESTIMATING MANUAL

Located on [Cost Estimating](https://www.cfm.va.gov/cost/index.asp) page on CFM website at <https://www.cfm.va.gov/cost/index.asp>.

Purpose

To convey the general and specific VA cost estimating philosophy for medical facilities.

The Manual accomplishes this by:

- Explaining specific estimating methodologies
- Presenting examples of certain design elements

1.5.13 SUSTAINABLE DESIGN MANUAL

Located in [Technical Information Library](https://www.cfm.va.gov/til/sustain.asp) at <https://www.cfm.va.gov/til/sustain.asp>.

Purpose

To identify sustainability goals outlined in the Federal Mandates, and maps each goal to the appropriate LEED strategy for implementation. Possible methods to achieve the goals, budget considerations, case studies, and checklists are also included.

The Manual accomplishes this by:

- Prescribing the use of integrated design practices
- Providing strategies for optimization of energy performance
- Providing strategies for protection and conservation of water resources
- Providing strategies for enhancement of indoor environmental quality
- Providing strategies for reduction of environmental impact of materials

1.5.14 SEISMIC DESIGN REQUIREMENTS (H-18-8)

Located in [Technical Information Library](https://www.cfm.va.gov/til/seismic.asp) at <https://www.cfm.va.gov/til/seismic.asp>.

Purpose

To establish seismic requirements to ensure that all new and existing VA hospital facilities in seismic areas are designed to remain operational after an earthquake.

1.5.15 FIRE PROTECTION DESIGN MANUAL

Located in [Technical Information Library](https://www.cfm.va.gov/til/spclRqmts.asp#FS) at <https://www.cfm.va.gov/til/spclRqmts.asp#FS>



Purpose

To provide fire protection design criteria, including fire alarm requirements.

1.5.16 VA HOSPITAL BUILDING SYSTEM

The VA Hospital Building System (VAHBS) is a methodology based on a modular concept for planning, designing, and constructing hospitals.

The methodology has been used nationwide with success in capital and operating cost containment, shortened delivery schedules, and improved space utilization flexibility. All new and replacement VA hospital buildings should use the VAHBS system. Also consider using this system for major additions to existing hospitals where future adaptability is an important factor.

The A/E will find that systems schematic/design development efforts will occur much earlier in the overall planning/design process, due to the modular concept. Equipment selection and main distribution sizing should be evaluated as soon as the size and number of modules is determined.

Refer to VHA Program Guide PG-18-3, Design and Construction Procedures, Topic 3, VA Hospital Building System for further guidance.

1.5.17 COMPUTER AIDED FACILITIES MANAGEMENT REQUIREMENTS (CAFM)

VA intends to implement Computer Aided Facility Management (CAFM) systems in all new and replacement hospital construction, and in all existing hospitals, as feasible. The CAFM concept requires that all pertinent data regarding a facility be contained in a master digital database, accessible by facilities personnel at their workstations for use in operations, energy/cost management, and maintenance, and for planning modifications in facility infrastructure due to space utilization changes.

1.6 VA BIM STANDARD

Located in [Technical Information Library](https://www.cfm.va.gov/til/projReq.asp) at <https://www.cfm.va.gov/til/projReq.asp>.

Purpose

To establish the use of BIM for new facilities to ensure value in quality, timeliness, cost, and to maximize building performance during operations.

1.7 APPLICABLE CODES AND STANDARDS**1.7.1 GENERAL**

The A/E shall use and comply with latest pertinent Codes, Standards and Executive Orders for the design as required in the PG-18-3, Topic 1 - Codes, Standards and Executive Orders, as well as latest pertinent Codes and Standards shown below:

(a) American National Standards Institute (ANSI)



- (b)** American Society for Testing Materials (ASTM)
- (c)** Illuminating Engineering Society of North America (IESNA)
- (d)** Institute of Electrical and Electronic Engineers (IEEE)
- (e)** International Organization for Standardization (ISO), Standards for Protocols and Interfaces that include Open System Interconnections (OSI)
- (f)** The Joint Commission (formerly known as the Joint Commission on Accreditation of Healthcare Organizations – JCAHO), Environment of Care Guidelines and Standards
- (g)** National Fire Protection Association (NFPA): the A/E shall pay particular attention to the following publications:
 - NFPA 20 - Standard for the Installation of Stationary Pumps for Fire Protection
 - NFPA 70 - National Electrical Code (NEC)
 - NFPA 70B - Recommended Practice for Electrical Equipment Maintenance
 - NFPA 70E - Standard for Electrical Safety in the Workplace
 - NFPA 72 - National Fire Alarm and Signaling Code
 - NFPA 77 - Recommended Practice on Static Electricity
 - NFPA 99 - Health Care Facilities Code
 - NFPA 101 - Life Safety Code
 - NFPA 110 - Standard for Emergency and Standby Power Systems
 - NFPA 111 - Standard on Stored Electrical Energy Emergency and Standby Power Systems
 - NFPA 780 - Standard for the Installation of Lightning Protection Systems
- (h)** National Electrical Manufacturers Association (NEMA)
- (i)** Underwriters' Laboratories, Inc. (UL)

1.7.2 LOCAL CODES AND CONDITIONS

- (a)** The A/E shall bring to the attention of CO, PM and COR, in writing, local and regional climatic and geographic conditions, and provisions of local building codes that are significantly different from the codes and standards listed above. The A/E shall provide CO, PM and COR, in writing, with specific information on how the proposed design will reflect these conditions and codes. The A/E shall focus on local codes, code amendments, and/or conditions related to coastal, hurricane-prone, arctic, or seismically-active regions, or other climatic or regional conditions that warrant additional measures to protect the integrity of systems.
- (b)** Some VA facilities may maintain their own electrical design requirement documents to address the facilities' specific and unique electrical needs. Therefore, The A/E shall communicate and confirm with the Chief Engineer of Facility Management Services (FMS) to



ensure whether this is the case. If this is the case, the A/E shall inform the CO and AHJ of the existence of the local facility's document. The A/E shall submit in writing to the CO and AHJ - for review and approval - a list of local facility's requirements that are not addressed in this design manual, or requirements that contradict to the requirements of this design manual. The A/E shall incorporate the local facility's requirements into the design, only after receiving written approval from CO and AHJ.

1.7.3 LOCAL UTILITY

The A/E shall follow the rules and regulations of the local electric power utility company, known herewith as utility company, where applicable. The A/E shall investigate potential rebates or incentives offered by the utility company for the installation and use of energy saving equipment.

1.8 DESIGN REQUIREMENTS

- (a)** All conductors, transformer windings, and bussing in electrical power distribution system components shall be copper.
- (b)** Motors rated 1/2 HP and higher shall be 3-phase. Design and specifications shall be based upon 200V (volt) motors for 208V systems and 460V motors for 480V systems.
- (c)** Provide detailed schedules for switchgear, switchboards, distribution panelboards, branch-circuit panelboards, and motor control centers on the drawings. At a minimum, the schedules shall indicate equipment ratings, enclosure type, load descriptions, interrupting ratings, breaker/starter sizes, and connected and demand loads in kVA by phase. The A/E shall determine probable equipment sizes from several manufacturers. The A/E shall consider largest dimensions, and heaviest weights among all qualified manufacturers to ensure that working clearance requirements, space for future installations, and structural requirements are satisfied. The A/E shall ascertain that the electrical rooms are sufficiently sized to accommodate all electrical equipment.
- (d)** Specifications and CAD Standard Details:

The A/E shall include applicable specifications as part of the construction document. The A/E shall include applicable details in the construction document. The A/E shall follow the guidance below:

- VA Master Specifications (PG-18-1 Division 26) have been developed for typical electrical work. The A/E shall edit the appropriate sections to meet the project scope of work and specific project requirements, and latest applicable codes, at the time of project design.
- The A/E shall carefully coordinate specifications with the drawings so that all work required by the drawings is included in the specifications. Specification content that does not apply to the project shall be deleted.
- The A/E shall develop specifications for any system or equipment not addressed by the VA Master Specifications. The A/E shall submit such specification to CO, COR and AHJ



for review and approval to use in the project. Only after receiving written approval from CO and AHJ, the A/E can proceed to include such specifications into the project design.

- VA Master Electrical CAD Standard Details (PG-18-4 Division 26) have been developed for typical electrical work. The A/E shall edit appropriate standard detail(s) to be consistent with the project's specifications, specific project requirements, and in compliance with latest applicable codes, at the time of project design.

1.9 CRITERIA UNIQUE TO VA

1.9.1 DRAWINGS

- (a)** Refer to VA Design and Construction Procedures (PG-18-3), Topic 2 – Drawings, and the VA NCS Application Guide, for general drawing requirements.
- (b)** Consolidate notes and place them on the right-hand side of the sheet.
- (c)** Show scale, compass point, orientation, key plan, title, column grids and numbers, matchlines, room numbers, and titles corresponding to the Architectural drawings.
- (d)** Provide large-scale (minimum 1/4"=1') partial plans for areas such as Electrical Rooms, Generator Rooms, Main Computer Room, Telephone Equipment Room, Telecommunications Rooms, and Mechanical Equipment Rooms.
- (e)** It is mandatory to show the number of wires in each branch circuit conduit on the plans. Include the number of wires in all interconnecting conduits for all wiring devices, fixtures, and equipment.
- (f)** Provide 1/4-inch scale details of special equipment spaces, such as Laboratories, Radiology, Dietetic Areas, Surgical Rooms, Electrical Rooms and Electrical Closets.
- (g)** Conduit runs for all feeder circuits shall be shown on plans as close to the location of final installations as possible to avoid field installation conflicts which are likely to cause costly construction change orders and delays. These conduit runs shall be shown to run in parallel with the building outline and be coordinated with existing field conditions and new installations of electrical and other systems. These conduit runs shall have the appropriate number of pullboxes located at appropriate distances to facilitate efficient installation and maintenance.
- (h)** Branch circuit homeruns shall not have more than three circuits. Combining circuits is prohibited.
- (i)** At a minimum, the construction documents shall contain diagrams of the Normal, Emergency and Standby electrical power distribution systems:
 - Primary Service and Primary System Distribution (One-line Diagram)
 - Grounding Systems and components for the medium/low voltage service switchgears/switchboards to the low voltage distribution panels (One-line Diagram), including but not limited to grounding electrodes, grounding electrode conductors,



grounded conductors, ground bus, bonding jumpers, and equipment grounding conductors

- Secondary System Distribution (Riser Diagram)
- Secondary System Distribution (One-line Diagram)
- Grounding Riser Diagram
- Protective Relaying System, Power Monitoring and Control System (One-line Diagram)

1.9.2 SEQUENCE OF ELECTRICAL DRAWINGS

- Symbols and Abbreviations
- Demolition Plans
- Electrical Site Plan(s)
- Lighting Plans
- Power Plans
- Lightning Protection Plans (may be combined with roof and ground floor/site power plans on projects with few lightning protection components)
- Other Plans (if applicable)
- One-line Diagrams and Riser Diagrams
- Details
- Schedules, Summary Load Studies, Lighting Fixture Schedule

1.9.3 ABBREVIATIONS AND SYMBOLS

Use only the abbreviations and symbols shown in the VA Standard Details (PG-18-4) and the NCS Application Guide.

1.9.4 PROPRIETARY ITEMS

The A/E shall not use or show trade names or other indications that identify a product of an individual manufacturer on any project, unless specifically approved by CO and AHJ, in writing, and as follows:

- Where necessary to identify existing equipment.
- Where an existing system is to be extended and competitive manufacturers cannot meet performance, or dimensional requirements.
- Where required by a public utility or municipal system as a condition of its services, construction specifications developed by the A/E shall state this condition.



- Where there is an immediate and urgent need to provide continuous operation after a natural or man-made disaster such as earthquake, hurricane, fire, flood, tornado, act of terrorism, or vandalism.

The A/E may only use an individual manufacturer as a basis of design for the project, after receiving written approval from CO and AHJ.

1.10 CALCULATIONS

1.10.1 GENERAL

The A/E shall prepare and submit, or specify calculations, study and analysis, as required by the type of design work performed. The A/E shall use the calculations and study to justify and validate the project's electrical design requirements such as size of each feeder, branch circuit conductor, raceway, overcurrent protective device and withstand rating, equipment bus, generator, transformer, setting of each overcurrent protective device with adjustable characteristic to achieve selective coordination operation, required personal protective equipment (PPE) to meet arc flash energy levels, etc. It is the responsibility of the A/E to determine which calculations to perform and which calculations to specify for the Contractor to perform. CO, PM or COR reserves the right to request additional calculations to meet project scope and requirements.

The selection of specific electrical power equipment manufacturer in the design phase is likely to occur in NRM project, or in project that has a specific project requirement such as VA's need to have expeditious acquisition of electrical equipment. If specific electrical power equipment manufacturer is selected and known during the design phase, and to be installed in the construction phase, the A/E shall prepare and perform Fault Current, Protective Device Coordination Calculations and Study, and Arc Flash calculations study and analysis. The A/E shall use the Master Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY, as a basis to perform these tasks. The A/E shall provide written reports of all calculations, study and analysis to CO, PM, COR and the Contractor. The A/E shall coordinate and collaborate with CO, PM, COR, the Contractor, and the selected equipment manufacturer in setting and adjusting the electrical power equipment according to the results of the calculations, study and analysis. The purpose is to ensure that the manufacturer's equipment functions and operates safely as intended.

However, in a typical major and minor project, electrical power equipment manufacturer is not selected and known during the design phase. Selection of electrical power equipment manufacturer occurs during the construction phase, and this information is not available to the A/E during the design phase. Due to the different electrical characteristics of different manufacturers of the same equipment, not knowing the selected equipment manufacturer during the design phase impedes the A/E's ability to perform the Protective Device Selective Coordination Calculations and Study, and Arc Flash calculations and analysis to effectively accommodate final setting of over current protective devices. To mitigate this issue, the A/E shall include the Master Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE



COORDINATION STUDY, in the construction contract document, and follow additional guidance listed in Sections 1.10.2, 1.10.3 and 1.10.4.

1.10.2 FAULT CURRENT CALCULATIONS

The A/E shall prepare and submit calculations to CO, PM and COR at the design phase for the project's electrical distribution system which includes normal, EES and standby power systems. The available fault currents shall be included on the one-line diagram and/or riser diagrams. The available fault current (expressed in amperes, RMS symmetrical) shall be shown at each bus and electrical equipment such as switchgears, switchboards, distribution panelboards, panelboards, overcurrent protective device and transformer in the system. Supporting calculations (such as those resulting from a SKM PowerTools™ analysis) that justify the summary available fault currents on the one-line diagram and/or riser diagrams shall be submitted to CO, PM and COR separately in 8.5" x 11" hard-copy, and PDF format.

1.10.3 PROTECTIVE DEVICE COORDINATION CALCULATIONS

The A/E shall perform the protective device coordination calculations and study to ensure selective coordination for the project's electrical power distribution system which includes normal, EES and standby power systems.

The A/E shall perform the following:

- For project that the final selected electrical equipment manufacturer is selected and known in the design phase, and to be installed in the construction phase, refer to section 1.10.1 - General - for requirements.
- For project that selected electrical equipment manufacturer is not selected and known in the design phase, the A/E shall perform the preliminary coordination calculations and study. The A/E shall use the Master Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY, as a basis to perform the task. Objectives of the preliminary calculations and study are to establish a basis of design, and to assist the A/E in identifying locations where selective coordination can and cannot be achieved, as well as to enable the A/E to complete the preliminary arc-flash analysis.

The A/E shall base the calculations and study on a domestic electrical equipment manufacturer, and use this manufacturer's electrical data for the calculations and study. The A/E shall use the results of this coordination calculations and study to adjust the design (if needed), and to ensure that selective coordination is likely to be achieved throughout the system.

The A/E shall include the Master Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY, in the design as part of the construction contract document.

During the submittal review period in the construction phase, the A/E shall perform submittal review and analyze contractor's submittals required in the Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY. The A/E



shall inform CO, PM and COR of any deficiency in calculations and reports shown in the submittals that potentially affect the safety and function of the systems. The A/E shall recommend mitigating actions to CO, PM and COR (if needed). The A/E shall coordinate and collaborate with CO, PM and COR, the Contractor, and the selected equipment manufacturer in setting and adjusting of the protective devices and related equipment to ensure safe and functional systems.

1.10.4 ARC FLASH CALCULATIONS

Arc Flash calculations and analysis is dependent on the results of the Protective Device Coordination calculations and study. Notably, the actual protective device clearing time is essential for Arc Flash calculations and analysis.

- In a project where the equipment manufacturer is selected and known in the design phase, and to be installed in the construction phase, the A/E shall perform the Arc Flash calculations and analysis in the design phase. The A/E shall use the Master Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY, as a basis for this task.
- In a project where the equipment manufacturer is not selected or known in the design phase, the A/E is required to perform the preliminary Arc Flash calculations and analysis during the design phase. The A/E shall use the Master Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY, as a guide for this task. Moreover, the A/E shall include the Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY, in the construction contract document as part of the design.

During the submittal review period in the construction phase, the A/E shall perform submittal review and analyze the Contractor's submittals required in the Specification Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY. The A/E shall inform CO, PM and COR of any deficiency in calculations and reports shown in the submittals that potentially affect the safety and function of the systems. The A/E shall recommend mitigating actions to CO, PM and COR. The A/E shall coordinate and collaborate with CO, PM and COR, the Contractor and selected equipment manufacturer in the process of finalizing information for arc flash calculation and analysis.

1.10.5 LOAD CALCULATIONS

Prepare and submit load calculations that justify the size of each branch circuit and feeder, overcurrent protective device, transformer, and equipment bus (panelboard, switchboard, switchgear, automatic transfer switch, etc.). Calculations shall be performed at all voltage levels. The method of calculation shall be clearly presented in the drawings, including all applicable NEC diversity factors and non-coincident loads and their employment at various levels of the electrical system, as well as the capacity reserved for future load. Calculations may be in panel schedule and switchboard schedule format. It shall be possible for the VA reviewer



to follow the load flow from the lowest level to the highest level of the riser and one-line diagrams.

1.10.6 GENERATOR SIZING CALCULATIONS

Prepare and submit generator sizing report to CO, PM and COR. The report is intended to justify the size and type of each generator or paralleled fleet of generators, including but not limited to all loads downstream of the generator set(s) and the sizing impacts of proposed load steps, significant motor loads, non-linear loads, and capacity reserved for future loads. If applicable under NEC Article 517, demand factors and historical data used to justify generator set(s) sizing shall be clearly presented. The A/E may utilize computer software available through domestic and reputable generator manufacturers.

At the minimum, the report shall consist of:

- Detailed electrical load calculation for systems such as lighting, air conditioner, chiller, cooling towers, battery charger, imaging and medical equipment, motor, fire pump, UPS, shop machinery, general receptacle etc.
- Generator set requirements such as duty, voltage, phase, voltage dips etc.
- Load running and surge requirements
- Generator set configuration
- The A/E's recommendations and justifications of the selected generator set

1.10.7 VOLTAGE DROP CALCULATIONS

Prepare and submit calculations demonstrating compliance with the following voltage drop limits: 2% for feeders and 3% for branch circuits, taken at design load.

1.10.8 HARMONIC DISTORTION CALCULATIONS

For Energy Center projects only. Prepare and submit calculations estimating the voltage and current total harmonic distortion (THD) for buses rich in non-linear loads, typically Energy Center switchboards which feed large horsepower pump motors controlled by adjustable speed drives. Use these calculations to justify active or passive components to mitigate harmonic distortion.

1.10.9 LIGHTNING PROTECTION CALCULATIONS

Prepare and submit calculations as described in Annex L Lightning Risk Assessment of NFPA 780.

1.11 SEISMIC BRACING

1.11.1 REFERENCES

Refer to [H-18-8](#), "VA Seismic Design Requirements." ***Coordinate with the Structural Engineer so that seismic bracing is provided as required.***



1.11.2 DRAWINGS

Contract drawings shall show the detail methods of anchoring electrical equipment. Drawings shall include the size, number, and type of anchors and fasteners to be used to secure the equipment against the seismic forces and to meet codes. Calculations for equipment anchoring shall be performed by a licensed structural engineer.

1.11.3 EQUIPMENT BRACING

Refer to Section 13 05 41 for seismic bracing requirements. Typically, all lighting and power equipment, and related enclosures shall be seismically braced and/or anchored.

1.12 TRANSPORT SYSTEMS

Refer to PG-18-10, ELEVATOR DESIGN MANUAL for requirements. Refer to PG-18-10, FIRE PROTECTION DESIGN MANUAL for fire alarm connection requirements.

1.13 FIRE ALARM SYSTEMS

Refer to PG-18-10, FIRE PROTECTION DESIGN MANUAL for requirements. Fire alarm system design is the responsibility of the Fire Protection Engineer. The A/E shall only be responsible to perform electrical design for the fire alarm and protection systems. The electrical design is limited to the type, size of the branch circuit, and wiring connection to the fire alarm and protection panels.

1.14 RENOVATION TO EXISTING SITES AND BUILDINGS

1.14.1 DRAWINGS

For renovation projects, separate demolition drawings are required for all areas involved in the project. Specific detailing of interfaces between renovated and existing-to-remain conditions shall be clearly indicated on the drawings. The A/E shall fully describe existing equipment affected by a renovation project, including but not limited to existing equipment manufacturer, model, voltage, amperage, and A/C ratings, description, new devices installed, new wires and cables terminated, etc.

1.14.2 MODIFICATION VERSUS REPLACEMENT

Where equipment must be modified to be physically utilized in a project, the following items must be evaluated:

- (a)** Can the government look to one manufacturer for final responsibility of the modified equipment?
- (b)** Is there a legitimate cost saving by modifying the existing equipment rather than installing new equipment?
- (c)** What is the impact on operation and safety during and after construction?
- (d)** Will the equipment retain a valid UL-listing after modification?



1.14.3 AGE AND PHYSICAL CONDITION

- (a) The length of time in service and physical condition of wiring, devices, and equipment shall be reviewed prior to considering reuse.
- (b) The equipment shall be capable of remaining in use for a minimum of 15 years of additional life or having 60% of remaining life. If not, the equipment shall be replaced.
- (c) Where equipment has been in operation, physical inspection of terminals, insulation, switching contacts, control wiring, etc., shall be performed by the A/E. The A/E shall make recommendations for re-use of the equipment to CO, PM and COR.

1.14.4 PARTS AVAILABILITY

- (a) After the A/E's site surveys, the availability of spare parts for existing equipment shall be determined.
- (b) Where the project involves extending of an existing system but the existing equipment spare parts are not available, the A/E shall inform CO, PM and COR in writing of the situation. The A/E shall provide CO, PM and COR with written recommendations to mitigate the situation within 48 hours after the site surveys.

1.14.5 CONDUIT AND BOXES

- (a) Conduit and boxes shall be removed from existing walls that are to be demolished.
- (b) Conduit and boxes in existing walls that are to remain shall be abandoned in place (if not reused) and the boxes shall be provided with blank covers.
- (c) Conduit not intended for reuse in existing or new ceilings shall be removed back to the power, telecommunications, or signal system source from which it originates.
- (d) Conduit run in the existing concrete slab shall be saw-cut off as it enters the slab, and then sealed with approved sealant to prevent moisture access.

1.14.6 CONDUCTORS

- (a) The A/E may provide requirement on the drawings to have the existing conductors meggered to ensure insulation integrity. Existing conductors that visually have sign of deteriorated or damaged insulation shall be replaced with new.
- (b) All un-used conductors shall be removed back to the nearest junction box. Where the entire circuit is to be removed, the conductors shall be removed back to the power source from which they originate.
- (c) New conductors shall not be installed in existing conduit with existing conductors.

1.14.7 WIRING DEVICES

- (a) Remove devices that are not to be reused. Wiring is to be removed in its entirety. Boxes shall be blanked.



- (b) Existing receptacles and switches in good operating condition, located at accessible locations, may be reused. Non-Hospital Grade receptacles shall be replaced in all-patient areas with Hospital Grade receptacles.
- (c) Existing GFCI receptacles shall be replaced with new GFCI receptacles with self-test feature.

1.14.8 LIGHTING FIXTURES

- (a) Lighting fixtures that cannot be reused shall be removed, including their associated wiring to ceiling-mounted junction boxes.
- (b) Per Master Construction Specification requirements, fluorescent fixtures determined to be reusable in new or existing ceilings shall be cleaned, re-lamped, re-lensed, and re-ballasted prior to being put back to service. LED fixtures shall be replaced with new. Where existing exit signs are non-LED type, they shall be removed and replaced with an LED-type fixture.

1.14.9 PANELBOARDS

- (a) Consider panelboards for reuse if physical condition, voltage, current and interrupting ratings, and circuit capacity requirements are met.
- (b) Panelboards shall be installed in new or existing electrical rooms and closets. Panelboards shall not be installed in the corridor without written approval from CO, PM or COR. Refer to other sections of this manual for requirements.
- (c) In major secondary distribution renovation projects, existing panelboard backboxes may be used as pullboxes for branch circuit transfer. All branch circuit conductors shall be tagged to identify the circuit number to which they are being transferred in the new panel. Provide clear requirements in the contract documents directing the Contractor to revise the circuit numbers on all junction and device boxes, and wall plates for the entire run.

1.14.10 GOVERNMENT RETAINED EQUIPMENT

After consulting with CO, PM and COR, the A/E shall determine if the following items shall be retained by the government. The A/E shall provide CO, PM and COR with a list of existing equipment to be retained:

- Disconnects of 100A (amperes) Motors and larger
- Fire Alarm Devices
- Panelboards and Circuit Breakers
- Special Lighting Fixtures
- Special Receptacles
- Transformers
- Power components installed to provide temporary construction electrical service (if not the property of the Contractor)



1.14.11 CONTINUITY OF SERVICE

- (a) Electrical power services passing through construction area shall be maintained throughout the construction period.
- (b) All circuits serving areas adjacent to the construction area that are modified, as part of the construction project, shall be re-circuited as part of the construction project.
- (c) Provide temporary and/or modify existing lighting and power, and related services as required for construction-period's Interim Life Safety measures.

1.14.12 COMPATIBILITY

- (a) New equipment installed shall be compatible with existing components and systems to which it interfaces.
- (b) Electrical sequence of phasing and frequency for 3-phase system shall be compatible and consistent with the existing electrical power distribution system.



CHAPTER 2: RACEWAYS, WIRING, AND EQUIPMENT

2.1 RACEWAYS 2-3

2.1.1 CONCEALED AND EXPOSED 2-3

2.1.2 UNDERGROUND DUCTS AND CONDUITS..... 2-3

2.1.3 SPARE CONDUITS 2-3

2.1.4 UNDERFLOOR DUCT SYSTEMS..... 2-3

2.1.5 IMAGING ROOMS..... 2-4

2.1.6 POKE-THRUS/POWER POLES 2-5

2.1.7 ETHYLENE OXIDE STERILIZATION AREA 2-5

2.2 GROUNDING..... 2-5

2.2.1 GROUNDING ELECTRODES 2-5

2.2.2 EQUIPMENT GROUNDING CONDUCTORS 2-5

2.2.3 METAL CURTAIN WALL GROUNDING 2-5

2.3 LIGHTNING PROTECTION SYSTEM 2-6

2.4 MOTOR DISCONNECT SWITCHES..... 2-6



2.1 RACEWAYS

Install all wiring such as feeders, and branch circuit wirings in raceways. Raceways shall be as specified in PG-18-1, Master Construction Specifications, Division 26. Raceway shall comply with the definition of the NEC Article 100.

2.1.1 CONCEALED AND EXPOSED

- (a) Exposed conduit is acceptable where finished ceilings are not provided. Wherever it is impractical to conceal conduits, due to economic considerations or the need to accommodate existing field conditions, the A/E shall consult with CO, PM and COR to determine acceptable alternatives.
- (b) Electrical conduits may be installed in concrete walls and floors.
- (c) Surface metal raceways shall not be installed on the floor. Services to equipment in open non-patient care areas shall be served from under the slab, or through tele/power poles wired from the ceiling.
- (d) Primary-voltage feeders shall not be exposed on the exterior of buildings.

2.1.2 UNDERGROUND DUCTS AND CONDUITS

- (a) Underground ducts and conduits shall be encased in concrete. Direct burial conduit may be allowed only for outdoor lighting and power branch circuits.
- (b) The A/E shall make project-specific recommendations for reducing the concrete encasement requirement for certain ducts or conduits. The A/E shall consider the importance and physical security needs of the ducts or conduits involved. Ducts or conduits containing Essential Electrical System wiring shall not be exempt from the concrete encasement requirement.

2.1.3 SPARE CONDUITS

Where electrical capacity is reserved for future use, such as bussed space in panelboards, motor control centers, switchboards, and switchgear of all voltage levels, and where under-slab or underground conduit is used, the A/E shall provide spare under-slab or underground conduits to an accessible point. The number and size of conduits shall be appropriate to the equipment and amount of bussed space served.

2.1.4 UNDERFLOOR DUCT SYSTEMS

To facilitate flexibility in cable installations to accommodate furniture system layouts, it is an option for the A/E to incorporate a design of underfloor duct system in the project. If the A/E considers exercising this option in the design, the following guidance shall be complied with:

- (a) For new construction of large office areas, underfloor power, telecommunications, and signal systems ducts can be considered only for the following areas:



- Personnel Division
- Registrar Division
- Fiscal Division
- Supply Division
- Other - Any large open office spaces where future flexibility is desirable

(b) Provide duplex receptacle and telecommunications outlet fittings on the underfloor duct to suit the furniture layout.

(c) Space the underfloor ducts 1.5 M (5 ft) on centers. In structural steel frame buildings, use trench header and utilize the cellular steel as the raceway. Coordinate with the structural engineer to ensure that the proper cells are enclosed for raceway use.

2.1.5 IMAGING ROOMS

(a) Radiology, nuclear medicine, magnetic resonance imaging (MRI) rooms, and rooms with similar functions are hereby known as Imaging Rooms. These rooms often require a manufacturer-specific conduit and wiring trough system. If local VA Medical Center has selected a manufacturer, the A/E shall base the design on the manufacturer's shop drawings. Otherwise, the A/E shall base the design on a typical and similar imaging equipment system for bidding purposes.

(b) The A/E shall provide the following details on the electrical plans for the Imaging Room(s):

- **Power Plan:** the A/E shall provide complete design for general use receptacles, and electrical outlets. The A/E shall show main circuit and related equipment servicing the imaging equipment. The A/E shall confirm imaging equipment power requirement with manufacturer's shop drawings. The A/E shall verify with equipment manufacturer on the type of electrical power system that the imaging equipment is required to be connected to.
- **Lighting Plan:** the A/E shall provide complete lighting design. The A/E shall coordinate lighting locations with imaging equipment shop drawings and drawings from other design disciplines to avoid conflict in field installation.
- **Imaging Equipment Raceway Layout Plans:** the A/E shall show all surface-mounted and recess-mounted raceway systems. In the patient area, only recess-mounted raceway systems shall be used. The A/E shall show wiring tags for all raceway runs. The A/E shall coordinate existing field conditions, locations, sizes, and quantities of raceways and cables shown on manufacturer's shop drawings with drawings from other trades to avoid conflict in field installation.
- **Imaging Equipment Wiring Schedule:** the A/E shall show a schedule for all wiring tags indicating wiring destinations and locations/sizes/types/quantities of all raceways and wirings.



- **Imaging Equipment Shop Drawings:** the A/E shall confirm that the proposed imaging equipment layout as shown on manufacturer’s shop drawings meets latest applicable codes, regulations, and pre-existing building conditions. The A/E shall verify and coordinate the design with Imaging Equipment Manufacturer’s representative to ensure compliance with latest codes and regulations, and pre-existing building conditions.

2.1.6 POKE-THRUS/POWER POLES

In renovation projects for large administrative areas, use fire-rated poke-thru devices and/or power poles, as determined by CO, PM and COR.

2.1.7 ETHYLENE OXIDE STERILIZATION AREA

Determine the extent of the NEC-classified area (if any) in the vicinity of ethylene oxide sterilizers and provide an appropriate raceway system and devices.

2.2 GROUNDING

The grounding system shall be shown complete on the one-line diagram with all components and descriptions from the medium- or low-voltage service to the low-voltage panels, as applicable for each project. The grounding system shall be shown complete on the One-line Diagram for the Normal, Standby, and/or Essential Electrical Systems, including but not limited to generators, automatic transfer switches, electrical equipment, etc.

2.2.1 GROUNDING ELECTRODES

Galvanized steel or copper-clad steel electrodes may be used. All electrodes are to be of the same material for the entire project.

2.2.2 EQUIPMENT GROUNDING CONDUCTORS

All raceways shall contain an equipment grounding conductor. Coordinate with VA Master Specifications and show on the drawings.

2.2.3 METAL CURTAIN WALL GROUNDING

- (a) To help ensure that personnel are not exposed to electrical shock, all exterior metal sheathing of buildings shall be grounded.
- (b) For buildings with perimeters not exceeding 76 M (250 ft) the sheathing perimeters shall be grounded at diagonally opposite corners of the building.
- (c) For buildings with perimeters exceeding 76 M (250 ft) the sheathing perimeters shall be grounded such that the spacing between grounding points does not exceed 30 M (100 ft).
- (d) A ground point shall consist of a driven ground rod and brazed connection to the building sheath. A No. 6 AWG bare copper conductor shall be used to connect the sheath to the ground rod.



- (e) Where a lightning protection system is provided for the building, the sheath shall also be bonded at each down conductor location.

2.3 LIGHTNING PROTECTION SYSTEM

- (a) Lightning protection is mandatory for all Mission Critical buildings. For non-Mission Critical buildings, perform risk analysis per NFPA 780, Annex L, and provide a lightning protection system where $N_D > N_C$. Submit calculations to CO, PM and COR.
- (b) Lightning protection systems shall comply with NFPA 780 – Standard for the Installation of Lightning Protection Systems, and NFPA 70 – National Electrical Code.

2.4 MOTOR DISCONNECT SWITCHES

Provide all motors with a local disconnect switch (unfused unless required otherwise) located at the motor, at a maximum of 1.5 M (5 ft) away, or within line of sight. Clearly indicate this requirement on the construction document.



CHAPTER 3: RECEPTACLE AND POWER REQUIREMENTS

3.1 GENERAL 3-3

3.2 ESSENTIAL ELECTRICAL SYSTEM CIRCUITS 3-3

3.3 RECEPTACLE CIRCUITS 3-3

3.4 SPECIFIC APPLICATIONS..... 3-3

3.4.1 GROUND-FAULT CIRCUIT INTERRUPTER RECEPTACLES 3-3

3.4.2 SURGICAL/OPERATING ROOMS..... 3-3

3.4.3 ICU-CCU FOOT-WALL RECEPTACLES 3-4

3.4.4 EXTERIOR ELECTRICAL RECEPTACLES..... 3-4

3.4.5 WAITING, LOUNGE AND LOBBY AREAS 3-5

3.4.6 ANIMAL SURGERY ROOMS (RESEARCH) 3-5

3.4.7 SELF-ILLUMINATED EMERGENCY RECEPTACLES 3-5

3.4.8 CORRIDORS 3-5

3.4.9 KITCHENS..... 3-5

3.4.10 OFFICES AND ADMINISTRATIVE AREAS 3-6

3.4.11 LABORATORIES AND RESEARCH FACILITIES 3-6

3.4.12 PHYSICAL MEDICINE AND REHABILITATION SERVICE 3-6

3.4.13 PSYCHIATRIC PATIENT ROOMS 3-6

3.4.14 STAIRWELLS..... 3-6

3.4.15 INTERSTITIAL SPACES..... 3-7

3.4.16 TV/CCTV POWER RECEPTACLES..... 3-7

3.4.17 ELECTRICAL CLOSETS 3-7

3.4.18 MOTORIZED TREADMILLS..... 3-7



3.1 GENERAL

- (a) "Receptacle" refers to power duplex receptacle. Single receptacle shall be specifically and clearly called out and shown as single receptacle on drawings. Receptacle or single receptacle shall be shown on drawings using symbols in the PG-18-4 Standard Details and CAD Standards. Provide receptacles, ground-fault circuit interrupter (GFCI) receptacles, or other special purpose receptacles, as required by codes, project scope and requirements. All receptacles shall be duplex NEMA 5-20R unless otherwise noted. In patient care buildings, receptacles shall be UL-listed as Hospital Grade, in the size, type, and configuration required by codes, project scope and any specific project requirements.
- (b) The A/E shall refer to the appropriate Design Guide, where locations of most receptacle are shown on floor plans.

3.2 ESSENTIAL ELECTRICAL SYSTEM CIRCUITS

Refer to [CHAPTER 4, "ESSENTIAL AND STANDBY ELECTRICAL POWER SYSTEMS,"](#) for devices to be backed by an alternate source of power.

3.3 RECEPTACLE CIRCUITS

No more than six receptacles (twelve single receptacles) shall be installed on a single branch circuit for general use.

3.4 SPECIFIC APPLICATIONS

3.4.1 GROUND-FAULT CIRCUIT INTERRUPTER (GFCI) RECEPTACLES

- (a) GFCI receptacles shall have self-test feature.
- (b) Provide GFCI receptacles at all locations required by NFPA 70 and 99. GFCI receptacles shall not serve other receptacles from their load-side terminals.

3.4.2 SURGICAL/OPERATING ROOMS

- (a) Refer to the Surgical and Endovascular Services Design Guide for specific electrical guidance.
- (b) Isolated Power System (IPS):
- (1) In renovation projects that affect existing IPS, the A/E shall coordinate with CO, PM and COR to determine whether to modify an existing IPS, or to remove it and install new IPS and components. Normal power and Critical branch of the EES shall each be on its own IPS.
 - (2) In new projects, IPS and components shall be designed and installed to render a complete, safe and operational system complying with NFPA 70 and 99. Selected receptacles shall be connected to the appropriate IPS.



- (3) Normal power and Critical branch of the EES shall each be on its own IPS. A minimum of two (2) IPS panels connected to the Critical branch of the EES supplied by different transfer switches, and one (1) IPS panel connected to normal power shall be designed, installed, and located in each surgical/operating room. Two IPS panels – connected to the Critical branch of the EES - shall be mounted on the opposite walls to reduce the length of branch circuit runs.
- (4) In specific case where members of VA healthcare governing body (i.e. VHA Healthcare Technology Management, clinical, safety and engineering staff etc.) unanimously and definitively determines that the surgical/operating room is not considered wet procedure area as required and defined in the NFPA 99, the IPS design and installation is optional. If such case occurs, the A/E shall obtain a written waiver from the VA healthcare governing body and inform CO, PM and COR of the waiver in writing within 24 hours of the waiver receipt.
- (c) Each receptacle shall be connected to an IPS on a dedicated circuit in a dedicated homerun conduit, except for those receptacles mounted in the surgical booms or service columns, which may be wired two receptacles to a dedicated circuit. Multiwire circuits are prohibited.
- (d) VA prohibits GFCI receptacles in surgical/operating rooms.
- (e) Wall-mounted receptacles shall be 0.45 M (18 in) above the floor. Receptacles shall be mounted in a combined power and ground modules. This module is a combination of receptacles and ground jacks.
- (f) The need for a dedicated IPS for surgical lasers, and special receptacles for surgical lasers or portable equipment shall be determined on a project-by-project basis, and as required in the VA Surgical Design Guide. The A/E shall confirm in writing the need of such equipment with CO, PM and COR, in the design phase of the project.

3.4.3 ICU-CCU FOOT-WALL RECEPTACLES

Provide two receptacles on the footwall or side wall near the foot of beds in Intensive Care cubicles or Isolation Rooms. Feed these receptacles from different circuits in the respective Patient Bed Service Walls (PBSW). Refer to [CHAPTER 6](#) for PBSW requirements.

3.4.4 EXTERIOR ELECTRICAL RECEPTACLES

Provide exterior GFCI receptacles mounted in NEMA 3R weatherproof enclosures with 25 M (75 ft) spacing maximum, at the locations listed below. Additional exterior receptacles shall be provided in locations other than listed below, if required by project scope or requirements. Exterior receptacles shall have dedicated branch circuits. Each dedicated branch circuit may feed up to six exterior receptacles.

- Exterior walls of penthouses for maintenance of roof areas
- Major entrances to buildings



- Courtyards and enclosed (or partially enclosed) garden areas
- Loading docks and maintenance yards
- Major mechanical equipment enclosures
- Cooling towers
- Major service equipment enclosures
- Near sanitary sewer cleanouts close to building walls.

3.4.5 WAITING, LOUNGE AND LOBBY AREAS

Provide tamper-resistant receptacles every 2.4 M (8 ft) in waiting, lounge, and lobby areas.

3.4.6 ANIMAL SURGERY ROOMS (RESEARCH)

- (a) Design operating rooms for non-flammable anesthetics only.
- (b) Provide non-explosion proof, locking receptacles at ceiling locations and Hospital Grade receptacles at wall locations.
- (c) Provide eight single Hospital Grade power receptacles for general use at each table: four flush-mounted in the ceiling (two at each end of the table), and four distributed along the permanent wall(s) associated with the table.
- (d) Provide one power receptacle on each wall mounted at 1.2 M (4 ft) above the floor.
- (e) Provide portable X-ray outlet at 1.2 M (4 ft) above the floor.
- (f) Provide X-ray film viewers at 1.2 M (4 ft) above the floor to the bottom of the unit, if required by the project scope.

3.4.7 SELF-ILLUMINATED EMERGENCY RECEPTACLES

In rooms without general illumination on emergency power, emergency receptacles shall be of the self-illuminated type. Night lights, pilot lights, and instrument lights are not considered general illumination.

3.4.8 CORRIDORS

Provide receptacles for general use at no more than 15 M (50 ft) spacing and within 7.62 M (25 ft) of corridor ends., except those in Nursing Unit corridors, where receptacles shall be a maximum of 12 M (40 ft) spacing. Corridor receptacles shall have dedicated branch circuits. One dedicated branch circuit shall feed a maximum of six corridor receptacles.

3.4.9 KITCHENS

- (a) Coordinate requirements with kitchen equipment list. Provide appropriate receptacles for each cord-connected piece of kitchen equipment. Other equipment shall be permanently wired using liquid tight flexible conduit.



- (b) For equipment located on an island, provide island-mounted, waterproof, floor pedestal type receptacles.
- (c) Provide a means to disconnect electrical power to all equipment beneath Type I hoods if the fire suppression is activated.

3.4.10 OFFICES AND ADMINISTRATIVE AREAS

- (a) **Small Rooms:** Provide receptacles with 3 M (10 ft) maximum spacing as measured around the floor line, excluding doorways. For all linear wall space 1.5 M (5 ft) and greater, provide at least one receptacle for general and computer uses.
- (b) **Open Spaces and Large Rooms:** Install receptacles for large administrative rooms in underfloor raceways (if underfloor duck systems are considered in the design), or in Tele/Power poles. Refer to [SECTION 2.1.4, UNDERFLOOR DUCT SYSTEMS](#).

3.4.11 LABORATORIES AND RESEARCH FACILITIES

Refer to Research and Development (R&D) Design Guide.

3.4.12 PHYSICAL MEDICINE AND REHABILITATION SERVICE

- (a) **Occupational Therapy Preparation and Treatment Rooms, Occupational Therapy Clinics, and Manual Arts Therapy Clinics:** Provide heavy-duty multiple surface metal raceway 208V and 120V receptacles at 1.2 M (2 ft) intervals on all walls, with their centerlines located 1 M (40 in) above finished floor.
- (b) **Educational Therapy Classrooms:** Provide light-duty 120V surface metal raceway receptacles at 1 M (40 in) intervals on all walls, with centerlines located 1 M (40 in) above finished floor.
- (c) **Other Receptacles:** When appropriate, provide safety receptacles for other services in the RMS Area. Flush-mount all floor receptacles in treatment areas with appropriate removable covers.

3.4.13 PSYCHIATRIC PATIENT ROOMS

Provide tamper-resistant GFCI receptacles with beveled, metal-edged cover plates in psychiatric patient rooms. Cover plates shall have tamper-proof screws. Psychiatric patient room receptacles shall be on a dedicated circuit such that they may be shut off independently, without affecting other rooms.

3.4.14 STAIRWELLS

Provide a receptacle for cleaning equipment on every other floor landing.



3.4.15 INTERSTITIAL SPACES

Provide receptacles every other column. Where catwalks are installed instead of a walk-on platform, provide receptacles along the catwalks at 12 M (40 ft) spacing maximum. In addition, provide receptacles at each entrance to the interstitial space.

3.4.16 TV/CCTV POWER RECEPTACLES

Provide a receptacle in conjunction with each CCTV camera, CCTV monitor, and TV receiver. Such receptacles are not necessary where the equipment is low-voltage, powered by headend equipment or Power over Ethernet (PoE).

3.4.17 ELECTRICAL CLOSETS

Provide a receptacle with its centerline located 1 M (40 in) above finished floor adjacent to the room door.

3.4.18 MOTORIZED TREADMILLS

If not provided integral to the treadmill, provide an in-line circuit interrupter at the treadmill unit which requires manual resetting to restore power in the event of a power interruption.



CHAPTER 4: ESSENTIAL AND STANDBY ELECTRICAL POWER SYSTEMS

4.1 GENERAL 4-3

4.2 MIXED ESSENTIAL AND STANDBY ELECTRICAL POWER SYSTEMS 4-3

4.3 COMMISSIONING 4-3

4.4 EQUIPMENT AND RATINGS 4-3

4.4.1 GENERATORS..... 4-3

4.4.2 AUTOMATIC TRANSFER SWITCHES (ATS) 4-4

4.4.3 CONTROL NETWORK 4-4

4.4.4 DIESEL FUEL STORAGE 4-4

4.4.5 LOCATION..... 4-4

4.5 EXISTING FACILITIES 4-5

4.6 ESSENTIAL ELECTRICAL SYSTEMS FOR HOSPITALS 4-5

4.6.1 ENFORCING CODES..... 4-5

4.6.1.1 LIFE SAFETY BRANCH 4-5

4.6.1.2 CRITICAL BRANCH..... 4-6

4.6.1.3 EQUIPMENT BRANCH DELAYED-AUTOMATIC CONNECTION 4-8

4.6.2 (RESERVED)..... 4-10

4.6.3 ALTERNATE SOURCE OF POWER..... 4-10

4.7 ESSENTIAL ELECTRICAL SYSTEM FOR NURSING HOMES AND LIMITED CARE FACILITIES
..... 4-10

4.7.1 LIFE SAFETY BRANCH 4-11

4.7.2 CRITICAL BRANCH..... 4-11

4.7.3 ALTERNATE SOURCE OF POWER..... 4-11

4.8 ESSENTIAL ELECTRICAL SYSTEM FOR OTHER HEALTHCARE FACILITIES 4-11

4.8.1 ALTERNATE SOURCE OF POWER..... 4-11

4.9 ESSENTIAL ELECTRICAL SYSTEM FOR OTHER FACILITIES 4-12

4.9.1 BOILER PLANT AND ENERGY CENTER 4-12

4.9.2 FIRE STATION..... 4-12

4.10 STANDBY ELECTRICAL SYSTEM 4-12

4.10.1 REQUIREMENTS..... 4-12

4.10.2 SOURCE OF POWER..... 4-13





4.1 GENERAL

This section covers the Essential Electrical Systems (EES), and Standby Electrical Systems.

Patient Care Space - Categories 1, 2, 3 and 4 space - shall be as defined in the NFPA 70 (NEC) and 99.

4.2 MIXED ESSENTIAL AND STANDBY ELECTRICAL POWER SYSTEMS

- (a) For facilities where full standby power is required by the Physical Security and Resiliency Design Manual (PSRDM), it is permissible for the Standby Electrical System generators to provide power to the Essential Electrical System (EES), if the Standby Electrical System, as a whole, meets the requirement of the NFPA 70, 99 and 110, other applicable codes and standards.
- (b) Refer to [APPENDIX A, DRAWINGS](#) for more information on electrical power system topologies.

4.3 COMMISSIONING

- (a) In addition to installation acceptance testing specified in NFPA 110, a commissioning plan shall be developed, specified, documented, and executed to ensure proper operation of the Essential Electrical System, both its individual components and the system, as a whole. The commissioning plan shall include, but not be limited to, all sources of power, paralleling switchgear, transfer switches, fueling systems, and tank leak detection, interconnections to other systems, annunciators, load shedding, exercise functions, peak shaving, and communications pathways between equipment.
- (b) The A/E shall prepare control and operation drawing(s) or stipulate that the Contractor prepare them, as part of system commissioning and operations and maintenance documents. The drawings shall show all elements of the system and their interrelationships, including both power and control interconnections and sequences of operation. Physical locations of equipment shall be included.

4.4 EQUIPMENT AND RATINGS

4.4.1 GENERATORS

- (a) Generator ratings shall comply with the definitions stated in the ISO 8528 Standard.
- (b) Generators providing power to the EES or Standby Electrical System shall be diesel generators. Natural-gas generators are prohibited to provide power to the EES or Standby Electrical System.
- (c) Generator's radiator shall be an integral component of the generator. Radiator shall not be remotely mounted from the generator.
- (d) Generators used for the Standby Electrical System shall be rated as shown below:



- Limited Time Running Power (LTP); or
- Emergency Standby Power (ESP) if the maximum power available, that the generating set can deliver under test, utility power outage or other intentional power outage, is in compliance with the hours of operation per year for ESP rating. The A/E shall confirm and obtain written confirmation from CO, PM and COR in the design phase before incorporating this option into the design.

(e) If separate from the Standby Electrical System generators, generators dedicated to the Essential Electrical System (EES) shall be rated as Emergency Standby Power (ESP).

4.4.2 AUTOMATIC TRANSFER SWITCHES (ATS)

- (a) ATS shall be 4-pole where the neutral circuit conductor is transferred by the transfer equipment, and the Standby or Essential Electrical System is designed as a separately derived system. ATS shall include the bypass isolation option. ATS shall be open transition switching.
- (b) ATS serving Critical and Essential facilities with Category 1 and Category 2 spaces shall be at a maximum of 800 Amperes, and located to provide the highest practicable reliability in service to the load, which generally entails minimizing the switch-to-load distance.

4.4.3 CONTROL NETWORK

ATS, generator remote alarm systems, load shedding controls, and other interconnecting control components of the Standby Electrical System and/or the Essential Electrical System shall be networked over a fiber-optic communications network, which shall be installed in dedicated raceways and shall not be used to transport information of other systems. The ATS shall be monitored, tested, and operated from a single location; typically, the paralleling switchgear.

4.4.4 DIESEL FUEL STORAGE

Diesel storage tank(s) shall be provided with leak detection, and a means to prevent degradation of stored fuel due to oxidation, microorganism growth and corrosion.

4.4.5 LOCATION

- (a) Do not locate the first level of distribution of the Standby Electrical System or Essential Electrical System, such as the generators and paralleling switchgear, in the same room with other power systems.
- (b) In the generator paralleling switchgear or distribution switchboard, Life Safety Branch overcurrent protective devices shall occupy a dedicated section or sections.
- (c) In certain projects where installation of outdoor generator(s) is the only safe, practical, cost effective, efficient, and timely option to meet the demand of project scope and schedule, the A/E may include outdoor generator(s) in the design providing that the following conditions are complied with:



- A written waiver request shall be submitted to CO and AHJ under the guideline shown in this Electrical Design Manual - Section 1.1 – General. The A/E shall proceed with the design only after receiving written approval from CO and AHJ.
- If the deviation request is approved, the A/E shall specify the generator(s) to have proper sound-proof outdoor enclosure(s) to provide protection against engine noise, environment, fire hazard, as well as to provide protection for physical security and resiliency.

4.5 EXISTING FACILITIES

- (a) Variations in wiring arrangements in existing facilities are acceptable, if the performance and reliability specified in VA Master Construction Specifications and criteria herein are not compromised. Such variations may particularly occur with certain wiring in separate or common raceways, with certain functions connected to one or another system or branch, or with certain provisions for automatically or manually delayed restoration of power from the alternate (emergency) source of power.
- (b) The A/E shall submit a narrative describing the existing conditions and how the new design best meets the intent of applicable codes and provides an equivalent degree of performance and reliability.
- (c) When adding new ATS to an existing Essential Electrical System, the A/E shall match the existing pole switching configuration in terms of equipment and design, i.e., 3-pole or 4-pole transfer switches.

4.6 ESSENTIAL ELECTRICAL SYSTEMS FOR HOSPITALS

4.6.1 ENFORCING CODES

Essential Electrical System shall comply with the NFPA 70, 99, and 110.

4.6.1.1 Life Safety Branch

Shall supply power to loads per NFPA 70 and 99, and as described below:

- **Alarm and alerting systems:** Fire and Medical Gas Alarm Systems, and other required alarm systems
- **Automatic doors:** Used for building egress
- **Elevator cab:** Lighting and control system
- **Means of Egress:** Exit signs and egress lighting
- **Generator set and transfer switch locations:** Task illumination, battery charger for emergency battery-powered lighting units, and selected receptacles
- **Generator set accessories:** As required for generator performance



- **Telecommunications and Special Telecommunications Systems:** where used for issuing instructions during emergency conditions, including public address and Code Blue systems and Disaster Control or Emergency Communication Centers.

4.6.1.2 Critical Branch

Shall supply power to loads per NFPA 70 and 99, and as described below:

- **Acute Nursing:** Task illumination and selected receptacles
- **Stepdown Units:** Task illumination and selected receptacles
- **Anesthetizing Locations:** Task illumination, selected receptacles, and fixed equipment; task illumination includes battery back-up
- **Angiographic Laboratories:** Task illumination, selected receptacles, and selected power circuits
- **Blood, Bone, Eye, and Tissue Banks:** Task illumination, selected receptacles, and refrigerators
- **Cardiac Catheterization Laboratories and Rooms:** Task illumination, selected receptacles, selected power circuits and X-ray unit
- **Coronary Care Unit:** Task illumination, selected receptacles, selected power circuits and Patient Bed Service Walls (PBSW)
- **Emergency Room Treatment Areas and Life Support Rooms:** Task illumination, selected receptacles, selected power circuits and PBSW
- **General Patient Bedrooms:** Night lights, an alcove or a lavatory mirror light, selected receptacle per PBSW, if available, and a bathroom light
- **Hemodialysis Rooms:** Task illumination and selected receptacle for each dialysis unit PBSW
- **Human Physiology Labs:** Task illumination, selected receptacles, and selected circuits
- **Intensive Care Units:** Task illumination, selected receptacles, selected power circuits and PBSW
- **Isolated power systems in special environments**
- **Medication Rooms and Medication Preparation Areas:** Task illumination, selected receptacles, and refrigerators
- **Minor Operating Rooms:** Task illumination and selected receptacles
- Nurse Call systems
- **Nurses Stations:** Task illumination and selected receptacles



- **Pharmacy Dispensing Area (including Satellite Pharmacies):** Power files, laminar flow hoods, refrigerators, copier for transmittal of physicians' orders, task illumination, and selected receptacles
- **Psychiatric Bedrooms:** Task illumination (ceiling only)
- **Surgical Operating Rooms:** Task illumination (50% of the general lighting above the surgery table shall have battery backup), all X-ray units, and one film processor per suite
- **Surgical Recovery Rooms:** Lighting fixture over each bed, selected receptacle for each bed (or PBSW), night lights for each bed (or PBSW), and emergency alarm circuits
- **Telephone, Data Equipment Room and Closets, Telephone Operators Rooms, and Antenna Headend Equipment Rooms:** All UPS equipment, lighting, and receptacles.
- **Ward Treatment Rooms:** Task illumination and selected receptacles
- **Dental Suites:** Each ceiling track operatory surgical light, each dental operating unit, one duplex receptacle in each treatment area, and a storage refrigerator
- **Electrical Rooms:** 50% of lighting and 50% of receptacles; also provide additional battery-powered lighting main electrical room
- **Engineering Control Center and Mechanical Equipment Rooms:** UPS equipment, task illumination, and selected receptacles for operating and controlling internal auxiliary power, data gathering panels, control air compressors, dryers, and any electric control for heating, ventilating, and air-conditioning (HVAC) systems
- **Laboratory Service:** Task illumination, selected receptacles in areas used to continue essential functions or critical experiments in the event of power failure, fume hoods, exhaust fans, and refrigerators
- **Pharmacy Delivery Systems and Delivery Areas:** Task illumination, selected receptacles, dumbwaiter for delivery of STAT requests, and pneumatic tube system for STAT requests if no other delivery system is readily available
- **Respiratory Care Beds:** PBSW; when PBSW are not provided, task illumination and selected receptacle for each bed
- **Security Station:** Monitoring security alarm systems, task illumination, one receptacle, intrusion and duress alarms at agent cashier, pharmacy, drug storage room in warehouse, canteen office, canteen retail store room, and canteen storage
- **Imaging Rooms:** Task illumination and imaging equipment such as CT scan, nuclear medicine, gamma camera, X-ray etc.
- HVAC for Surgical Suites, Intensive Care, Coronary Care, and Emergency Treatment Spaces, and other areas as deemed necessary by VA
- Medical dispensing equipment



4.6.1.3 Equipment Branch Delayed-Automatic Connection

Shall supply power to loads per NFPA 70 and 99, necessary controls, and as described below:

- Central suction systems, vacuum pumps and oral evacuation pumps serving medical and surgical functions, including controls
- Sump pumps and other equipment such as associated control systems and alarms required for the safety of major equipment that may be exposed to water
- Medical and dental air compressors serving medical and surgical functions, including controls (such systems may be connected to the Critical Branch; the A/E shall coordinate with the Chief Engineer at the facility)
- Smoke control and stair pressurization systems
- Kitchen hood supply and/or exhaust systems, if required to operate during a fire in or under the kitchen hood
- Uninterruptible Power Supply (UPS) equipment serving other than telecommunications equipment
- Medical and laboratory refrigerators and freezers as required
- Oxygen storage control panel
- Equipment and control systems for each elevator bank: Design control systems to operate at least one elevator at a time and designate one elevator to serve the Surgical Suite during emergencies
- Jockey pump, and make-up pump for water-based fire protection systems; air compressor for dry-type fire protection systems; lighting and selected receptacles in fire pump room
- Hyperbaric facilities
- Hypobaric facilities
- Automatic operated doors
- Autoclaving equipment (shall be permitted to be arranged for either delayed-automatic or manual connection to the alternate source)
- **Administrative Areas:** Task illumination and selected receptacles in the hospital Director's, Engineering, and VA Police Operations
- Closed-loop water chilling equipment for linear accelerator
- **Domestic Water Pumps:** Equipment, control system, light fixture, and receptacle near the pump
- Electric tape for heat tracing of piping requiring freeze protection
- Heating, ventilating and air-conditioning (HVAC) systems:



- **Heating Equipment:** Operating Suites, Recovery, Intensive Care, Coronary Care, Infection and/or Isolation Rooms, Emergency Treatment Spaces, and General Patient Rooms; under certain conditions, NFPA 99 may not require heating of General Patient Rooms and Infection Isolation Rooms
- Air-conditioning equipment, lubricating oil pumps for centrifugal compressors, control air compressors, air dryer and absorption machine refrigerant pump to draw down lithium chloride before crystallization (omit for machines accomplishing this manually)
- Chillers, chilled water circulating pumps, fans, and controls for surgical suites, recovery rooms, intensive care, and coronary care units
- Chillers, chilled water circulating pumps, fans, and controls for animal research facilities
- HVAC equipment for Bone Marrow Transplant (BMT) areas
- HVAC equipment for Magnetic Resonance Imaging (MRI) Suites and Computerized Topographic (CT) Scanners
- HVAC equipment serving emergency areas in outpatient clinics in seismic and high-risk hurricane areas
- HVAC equipment for Main Computer Room, Telecommunications Rooms, Telephone Operators Room, and Antenna Headend Equipment Room
- Exhaust fans serving Autopsy Rooms, reagent-grade Water Treatment Rooms, Orthotic Laboratory special exhaust systems, battery charging areas, flammable storage rooms, and illustration rooms (Medical Media)
- Supply, return, and exhaust ventilating systems for Infection Isolation Rooms, Protective Environment Rooms, and exhaust fans for laboratory fume hoods and nuclear medicine areas where radioactive material is used, ethylene oxide evacuation and anesthesia evacuation. These systems are permitted on delayed automatic system only, and shall not be served via manual system. Some systems may be placed on the Critical Branch of the EES. The A/E shall coordinate with VA.
- Ventilation, cooling, and control equipment for electrical rooms
- Ventilation, cooling, and control equipment for elevator machine rooms
- **Hot Water Circulatory and Steam Condensate Return Pumps:** Equipment, controls, and light fixture and receptacle near the pumps
- **Hot Water Generator:** Equipment, controls, and light fixture and receptacle near the generator
- **Kitchen:** Illumination and minimum equipment to provide nourishments to patients during extended outage; freezers and refrigerators



- **Laboratory Air Compressors and Vacuum Pumps:** Equipment, controls, and light fixture and receptacle near the compressors and pumps
- Animal Ward illumination
- **Mortuary Refrigerator or Cold Room:** Refrigeration equipment and task illumination
- **Radiology Suite:** Task illumination, one automatic X-ray film processor, and one X-ray unit
- **Refrigerated Medical Storage:** Refrigeration equipment
- **Sewage Pumps:** Equipment, controls, and light fixture and receptacle near the pumps
- **Sterile Processing Service (SPS):**
 - Task illumination and selected receptacles in the following areas: core, sterile storage, non-sterile storage, preparation, and decontamination
 - One ultrasonic cleaner, one ethylene oxide gas sterilizer, one steam sterilizer, one washer sterilizer, and one gas generator, as well as all supporting equipment
 - Equipment in warehouse areas necessary to preserve subsistence drugs and X-ray film materials that may be subjected to damage from infestation, humidity, or temperature
- **Water and Sewage Treatment Plant:** Illumination, receptacles, and equipment needed during emergency

4.6.2 (Reserved)

4.6.3 ALTERNATE SOURCE OF POWER

- (a) All requirements for the alternate source of power shall comply with NFPA 70, 99, 110, applicable codes and standards, and the PSRDM.
- (b) The alternate source of power shall be diesel engine-driven generator sets. Source of power for emergency and EES systems - that is located in a centralized area or energy center of the facility - shall have N+1 generator redundancy configuration, as shown in the Appendix A - Single Line Diagrams.
- (c) Provide additional physical space for any future generator(s). Paralleling switchgear and related equipment shall be appropriately provisioned in the design.
- (d) Coordinate location(s) for generator remote alarm annunciator(s) with PM and COR. The preferred locations are in the Energy Center control room and in the Security office, or Telephone Operators Room (whichever is continuously staffed).

4.7 ESSENTIAL ELECTRICAL SYSTEM FOR NURSING HOMES AND LIMITED CARE FACILITIES

Essential Electrical System shall comply with NFPA 70, 99 and 110.



4.7.1 LIFE SAFETY BRANCH

Shall supply power to loads per NFPA 70 and 99.

4.7.2 CRITICAL BRANCH

(a) Shall supply power to loads per NFPA 70 and 99.

(b) In addition, connect the following items to the Critical Branch, arranged for delayed-automatic connection to the alternate power system:

- Nurse Call System
- **Patient Bedrooms:** Bathroom light, an alcove or lavatory mirror light, night light, and selected receptacle per PBSW.
- **Electrical Rooms and Closets:** 50% of lighting and one receptacle
- Main Computer Room, Backup Computer Room, Telecommunications Rooms, Telephone Operators Room, and Antenna Headend Equipment Room: All UPS equipment, lighting, and receptacles.
- **Mechanical Rooms:** Task illumination and one receptacle

4.7.3 ALTERNATE SOURCE OF POWER

(a) All requirements for the alternate source of power shall comply with NFPA 70, 99, 110, applicable codes and standards, and the PSRDM.

(b) For facilities that are designated as Ancillary by the PSRDM, the A/E shall verify and confirm with CO, PM and COR whether alternate source of power is required for the project. If alternate source of power is required, the A/E shall incorporate into the design an alternate source of power which consists of diesel engine-generator set(s).

(c) For facilities that are designated as Critical or Essential by the PSRDM, comply with this design manual's section 4.6.3 – Alternate Source of Power.

4.8 ESSENTIAL ELECTRICAL SYSTEM FOR OTHER HEALTHCARE FACILITIES

Essential Electrical System shall comply with the latest NFPA 70, 99 and 110.

4.8.1 ALTERNATE SOURCE OF POWER

(a) All requirements for the alternate source of power shall comply with NFPA 70, 99, 110, applicable codes and standards, and the PSRDM.

(b) For facilities that are designated as Ancillary by the PSRDM, the A/E shall verify and confirm with CO, PM and COR whether alternate source of power is required for the project. If alternate source of power is required, the A/E shall incorporate into the design an alternate source of power which consists of a diesel engine-generator set and all related equipment.



- (c) For facilities are designated as Critical or Essential by the PSRDM, comply with this design manual's section 4.6.3 – Alternate Source of Power.

4.9 ESSENTIAL ELECTRICAL SYSTEM FOR OTHER FACILITIES

4.9.1 BOILER PLANT AND ENERGY CENTER

Provide emergency power for task illumination and equipment necessary for emergency operations during an extended power outage. These buildings generally have their own diesel engine-driven generator set.

4.9.2 FIRE STATION

Provide emergency power for lighting and communication equipment necessary to sustain operation during power outages. If emergency generator power from an adjacent Boiler Plant or Energy Center is not available, provide auxiliary battery-powered lighting and communication devices.

4.10 STANDBY ELECTRICAL SYSTEM

4.10.1 REQUIREMENTS

Standby Electrical System shall comply with the PSRDM, and as described below:

- (a) All requirements for the alternate source of power shall comply with NFPA 70, 99, 110, applicable codes and standards, and the PSRDM.
- (b) Standby electrical system shall comply with the NEC Section 702 Optional Standby Systems.
- (c) For Critical and Essential facilities, PSRDM requires a Standby Electrical System to provide backup power to support continued operations. The Standby Electrical System shall be sized for full load operation of the entire electrical system. The Standby Electrical System must be capable of sustaining operation of all electrical loads, during and following an extreme event, for the duration as required in the PSRDM. Additional sustainability time may be required for hurricane-prone areas, arctic areas, high-seismic areas, areas vulnerable to other natural disasters, Continuity of Operation (COOP) facilities, or for other locations as specified by CO, PM and COR.
- (d) The Standby Electrical System may be sized to provide power for other new or existing buildings or loads in addition to the full facility electrical loads. The A/E shall coordinate this aspect of the project with CO, PM and COR during the planning phase, and incorporate it in the design.
- (e) Standby electrical system's overcurrent devices shall be selectively coordinated with all supply-side overcurrent protective devices.



4.10.2 SOURCE OF POWER

- (a) Source of power shall be diesel engine-driven generator sets that generate at the utility service entrance voltage, typically 5kV or 15kV nominal. The point of connection shall typically be the utility service entrance point. The generators shall comply with all requirements stated in this chapter.
- (b) Sources of power providing power to both the EES and optional standby systems shall have N+1 generator redundancy configuration, as shown in the Appendix A.
- (c) Sources of power providing power only to the optional standby system shall have N+1 generator redundancy configuration, unless this configuration is not required in the project. The A/E shall verify and confirm in writing whether N+1 generator redundancy configuration is required with CO, PM and COR.
- (d) Provide physical space for any additional future generator(s). Paralleling switchgear and other related equipment shall be appropriately provisioned in the design.
- (e) Investigate peak shaving, cogeneration, or load interruption incentives with the serving electrical utility and submit an analysis narrative with recommendations to the CO, PM and COR. Unless an advantageous interconnection agreement is obtained, the standby power system shall not parallel with the utility.
- (f) The location of the standby power system, including switchgear and diesel fuel storage, shall comply with this design manual, PSRDM, latest applicable Codes and standards.



CHAPTER 5: ELECTRICAL POWER DISTRIBUTION

5.1 UTILITY SERVICE.....5-3

5.2 PRIMARY DISTRIBUTION 5-3

5.2.1 GENERAL 5-3

5.2.2 PRIMARY SWITCHGEAR 5-3

5.2.3 PRIMARY CABLING 5-4

5.2.4 SUBSTATION PRIMARY-VOLTAGE DISCONNECTING MEANS 5-4

5.3 SECONDARY DISTRIBUTION 5-4

5.3.1 GENERAL 5-4

5.3.2 MEDIUM-TO-LOW VOLTAGE TRANSFORMERS 5-4

5.3.3 LOW VOLTAGE TRANSFORMERS 5-4

5.3.4 SWITCHGEAR, SWITCHBOARDS, AND MOTOR CONTROL CENTERS..... 5-5

5.3.5 BRANCH-CIRCUIT PANELBOARDS 5-5

5.3.6 TYPE 2 SURGE-PROTECTIVE DEVICES (TYPE 2 SPD)..... 5-5

5.3.7 LOADS FED FROM UNINTERRUPTIBLE POWER SUPPLY (UPS)..... 5-5

5.4 POWER MONITORING AND METERING 5-5

5.4.1 GENERAL 5-5

5.4.2 ENERGY CENTERS 5-6

5.4.3 EXISTING FACILITIES 5-6

5.5 ELECTRICAL ROOMS AND CLOSETS..... 5-6

5.5.1 GENERAL 5-6

5.5.2 SPACE FOR FUTURE EQUIPMENT 5-7

5.6 ELECTRICAL FACILITIES FOR SURGICAL/OPERATING ROOMS 5-7

5.7 ELECTRICAL FACILITIES FOR ELEVATORS..... 5-7



5.1 UTILITY SERVICE

- (a) Any utility service that enters VA property to access VA service equipment shall be installed underground in a concrete-encased duct bank.
- (b) Primary (medium-voltage) service is preferred. The service voltage should not exceed 15 kV. The use of higher voltages up to 35 kV shall be considered for review and approval by CO and AHJ in writing, if cost-effective and in compliance with the utility company's rules and regulations.
- (c) The A/E shall comply with the requirement of the PSRDM for the number and location of the primary electric utility sources. If two sources are required, and if it is cost inhibitive or almost impossible for the Utility Power Company to meet this requirement, A/E shall inform CO, PM and COR in writing of the situation and recommend solutions. The A/E shall obtain CO and AHJ's authorization to deviate from this requirement. Provide a cost opinion for the second utility service to aid VA in determining the cost-effectiveness of this requirement.

Ensure that required easements for utility conductors and equipment are provided in accordance with the requirements of the Utility Power Company.

5.2 PRIMARY DISTRIBUTION

5.2.1 GENERAL

- (a) Distribution topology shall be primary selective, secondary radial.
- (b) Primary radial systems are acceptable only with written approval of CO, PM and COR for Ancillary facilities.
- (c) Refer to [APPENDIX A, DRAWINGS](#) for electrical power system topologies.
- (d) Refer to the PSRDM for more information.

5.2.2 PRIMARY SWITCHGEAR

- (a) Primary switchgear shall be located indoors, in a secure, protected location, and shall comply with the PSRDM. The area shall have the necessary ventilation or cooling systems to maintain indoor temperature as required for proper operation of the equipment, as well as access control. Equipment shall be located above grade and above the 100-year floodplain with flood elevation as required by the PSRDM.
- (b) Refer to the PSRDM for feeder protection and routing requirements.
- (c) For Critical and Essential facilities, primary switchgear shall be metal clad. Circuit protective devices shall be electrically operated, draw-out type circuit breakers with electronic relays.
- (d) For Ancillary facilities, primary switchgear may be located outdoors, and may be pad-mounted fused-switch type.



5.2.3 PRIMARY CABLING

- (a) Primary cabling shall be installed underground, in concrete-encased ductbanks. Each ductbank shall contain ducts for planned future expansion, as well as 25% additional ducts for unplanned future expansion. Route ductbanks to avoid possible locations of future building foundations or other structures. To the extent practical, normal and standby power feeders shall be physically separated, and shall not be routed in the same ductbank.
- (b) Consider the use of 15kV cable for 5kV projects.

5.2.4 SUBSTATION PRIMARY-VOLTAGE DISCONNECTING MEANS

- (a) Primary feeders' substation connections shall be provided with circuit protective devices. Circuit protective devices shall be electrically operated, draw-out type circuit breakers with electronic relays for Critical and Essential facilities.

5.3 SECONDARY DISTRIBUTION

5.3.1 GENERAL

Critical and Essential Facilities with Category 1 and Category 2 spaces - 1000 kVA or Larger Demand Load: The total building load (calculated demand kVA plus future growth) shall be served by multiple single-ended unit substations. Low-voltage feeders between buildings shall be underground.

5.3.2 MEDIUM-TO-LOW VOLTAGE TRANSFORMERS

- (a) The maximum transformer size for 208Y/120V systems shall be 750kVA. The maximum transformer size for 480Y/277V systems shall be 2500kVA. Transformers may be dry or liquid-filled.
- (b) Outdoor pad-mounted transformers are permitted only for Ancillary facilities.

5.3.3 LOW VOLTAGE TRANSFORMERS

- (a) The A/E shall consider harmonic-mitigating dry-type transformers such as K-type transformers to serve building areas rich in non-linear loads such as computers and data equipment.
- (b) VA discourages the design, installation and use of low-voltage step-up dry-type transformers (i.e. 208Volt – 3 phase primary, stepping up to 480/277Volt – 3 phase or 480Volt – 3 phase secondary). However, in the situation where step-up dry-type transformer is the only safe and practical design option, the A/E shall design and specify only transformers listed for such application by UL and the equipment manufacturers. The practice of “reverse-feeding” to achieve step-up voltage of low-voltage dry-type transformers not listed by UL and equipment manufacturers shall be prohibited.



5.3.4 SWITCHGEAR, SWITCHBOARDS, AND MOTOR CONTROL CENTERS

- (a)** Provide switchgear, switchboards, and motor control centers with 25% space for additional overcurrent protective devices. Horizontal bussing should be fully rated for length of switchboard.
- (b)** As a guideline, power circuit breakers are preferred for 1600A and above; molded case circuit breakers for below 1600A. Select electronic trip functions for low-voltage circuit breakers to achieve selective coordination per the NEC and NFPA 99.

5.3.5 BRANCH-CIRCUIT PANELBOARDS

Provide each branch-circuit panelboard with 20% space for future circuit breakers.

5.3.6 TYPE 2 SURGE-PROTECTIVE DEVICES (TYPE 2 SPD)

- (a)** Type 2 SPD, as defined by NEC, is mandatory for buildings equipped with a lightning protection system.
- (b)** Integrated, cascaded Type 2 SPD is mandatory at all Critical and Essential facilities at the highest secondary voltage ("service entrance") level, at downstream panelboards that serve sensitive electronic equipment, and at individual receptacle locations by the use of SPD receptacles. Type 2 SPD is recommended at these locations in Ancillary facilities.

5.3.7 LOADS FED FROM UNINTERRUPTIBLE POWER SUPPLY (UPS)

- (a)** UPS equipment is necessary for electronic equipment or any equipment that performs critical functions and requires continuous regulated power for operation.
- (b)** At a minimum, the following loads should be protected by UPS equipment: Main Computer Room equipment, Telephone Equipment Room equipment, telecommunications/special system telecommunications equipment, HVAC control equipment, and any other mission-essential equipment necessary for continuity of service that is not tolerant of the transfer time between utility and generator power.
- (c)** UPS equipment shall be arranged so that the required runtime is achieved by paralleled combinations of shorter runtime battery cabinets.

5.4 POWER MONITORING AND METERING

5.4.1 GENERAL

- (a)** Power monitoring and metering are in addition to utility metering.
- (b)** At a minimum, power monitoring and metering equipment shall be provided for normal, EES, and Standby power systems: for medium-voltage switchgear on each main, tie circuit breaker and distribution feeder circuit breaker, unit substation transformer secondary low-voltage main circuit breakers, generator paralleling switchboards, plug-in busways, and low-voltage switchboards and major distribution panelboards. The power monitoring and



metering system shall have the capability of communication with a VA-centralized remote metering station via a data backbone.

- (c) At a minimum, power monitoring and metering equipment shall record, store, and trend voltage, current, kW, kWh, kVA, kVAR, power factor, as well as voltage and current total harmonic distortion.

5.4.2 ENERGY CENTERS

- (a) Provide power monitoring and metering for chilled water plants and boiler plants.
- (b) If medium-voltage chillers are used, install power monitoring equipment for each chiller.

5.4.3 EXISTING FACILITIES

If feasible, renovation projects shall install power monitoring equipment on any major electrical equipment directly affected or modified by the renovation.

5.5 ELECTRICAL ROOMS AND CLOSETS

5.5.1 GENERAL

- (a) An electrical room is an area in a building or structure which contains the following electrical equipment: medium-voltage switchgear, medium-to-low-voltage transformers, low-voltage transformers, low-voltage distribution equipment and panelboards. An electrical closet is an area in a building that contains the following electrical equipment: low voltage transformers and low-voltage distribution and branch-circuit panelboards.
- (b) The location, protection, and access to electrical room and closets shall comply with the PSRDM.
- (c) Electrical rooms shall be located above the Base Flood Elevation. Electrical rooms or closets shall not be located beneath rooms with toilets, showers or sinks, laboratories, kitchens, open courtyards, planters, roof drain leaders, or other rooms or areas where water service is provided.
- (d) Electrical equipment spaces shall be designed to comply with VA Design and Construction Procedures - PG-18-3 Topic 8 Electrical Rooms and Closets, and the NEC's required working clearance of electrical equipment, maintenance equipment access, and to facilitate equipment replacement without significant demolition and reconstruction.
- (e) Any pipe or duct system foreign to the electrical installation shall not enter or pass through an electrical space. The A/E shall ensure that foreign piping such as water pipes, steam pipes, medical gas pipes, sanitary waste pipes, roof drains, A/C ducts, and other unrelated piping systems containing liquids or gases are not installed, nor pass through the electrical rooms. Sprinkler piping shall not be routed through electrical rooms, unless it serves to protect the electrical installation.
- (f) Electrical spaces shall have the necessary mechanical ventilation or cooling system to maintain the indoor temperature range required for proper operation of the equipment.



- (g) No telecommunications equipment, other than telecommunications outlets, shall be placed within electrical rooms.
- (h) Provide appropriate construction for the type of transformer(s) installed.
- (i) Electrical closets shall stack vertically. Electrical closets shall locate horizontally at a maximum of 46 M (150 ft) apart, to limit maximum 120V branch-circuit wiring run to approximately 23 M (75 ft).

5.5.2 SPACE FOR FUTURE EQUIPMENT

- (a) Rooms that contain freestanding electrical equipment shall be sized so that sufficient space is provided to add one additional section to each unit of freestanding equipment. Provide extended pad space and spare conduits to facilitate future installation of equipment and conductors. Spare space shall be indicated on drawings.
- (b) Electrical closets shall have 20% spare wall space for future installation of similar electrical equipment.

5.6 ELECTRICAL FACILITIES FOR SURGICAL/OPERATING ROOMS

Refer to Design Guides (PG-18-12), Surgical and Endovascular Services.

5.7 ELECTRICAL FACILITIES FOR ELEVATORS

Refer to the VA Elevator Design Manual.



CHAPTER 6: SPECIAL MEDICAL AND ALARM SYSTEMS

6.1 GENERAL 6-3

6.2 PATIENT BED SERVICE WALL SYSTEMS 6-3

6.3 PATIENT BED SERVICE WALLS (PBSW) 6-3

6.4 PBSW INSTALLATION 6-3

6.5 PBSW APPLICATION 6-3

6.6 MEDICAL GAS, VACUUM, AND AIR ALARM SYSTEMS 6-4



6.1 GENERAL

VA uses nonflammable anesthetics in Operating Rooms of Surgical Service and Medical Research Service. Installations in these areas shall conform to the NFPA 99 that pertain to nonflammable anesthetics.

6.2 PATIENT BED SERVICE WALL SYSTEMS

In certain intermediate and critical care areas, VA requires the installation of Patient Bed Service Wall systems in patient bedrooms/areas. Refer to the VA Master Specification Section 10 25 13, Patient Bed Service Walls, for requirements. The A/E shall edit applicable requirements of this specification section to comply with project scope, specific project requirements, and latest NFPA 70 and 99.

6.3 PATIENT BED SERVICE WALLS (PBSW)

- (a) Each OEM produced-PBSW contains a specific UL Rating, Listing, and Labeling for acute medical applications. Under no circumstance shall any second party equipment be attached or installed in the PBSW without written authorization from the PBSW OEM.
- (b) During installation or VA Proof of Performance testing and certification: if a PBSW is found to have equipment installed or attached that violates its UL ratings, it shall be the responsibility and expense of the contractor to restore the respective UL rating(s) per the written instructions of the PBSW OEM and the UL. Once the corrections are made, each affected unit shall be re-inspected by SMCS-005OP2H3 at the Contractor's Expense. Contact VA's AHJ SMCS-005OP2H3. Refer to Telecommunication/Special System Telecommunication Design Manual (TDM) for information.

6.4 PBSW INSTALLATION

- (a) Install PBSW in accordance with the VA Master Specification 10 25 13, Patient Bed Service Wall, and equipment manufacturer's recommendations.
- (b) All PBSW shall be surface-mounted on the patient headwall.
- (c) All installations in one-bed room shall be at the head and to the corridor side of the bed.
- (d) All PBSW to be located between a pair of beds in multi-bed areas shall be centered between the beds. If an odd bed remains, apply the one-bed room concept.

6.5 PBSW APPLICATION

Table 6-5 describes the type (as defined in specification section 10 25 13, Patient Bed Service Walls, and quantity of PBSW in main patient bed locations.



Table 6-5 PBSW Application

BED AREA	PBSW TYPE	QUANTITY
AMBULATORY CARE		
Observation and Treatment Room	Style A1	Each Bed
Life Support	Style C	Each Bed
DIALYSIS CENTER		
One-Bed Room	Style B2	Each Bed
Multi-Bed Room	Style B2	Each Bed
INTENSIVE CARE UNITS		
Coronary	Style C	Each Bed
Surgical	Style C	Each Bed
Medical	Style C	Each Bed
General Purpose	Style C	Each Bed
NURSING UNITS		
Intermediate Care	Style A1	Each Single Bed
Intermediate Care	Style A2 (25% of total beds in unit)	Between Each Pair of Beds
MS&N (Medical, Surgical Neurological, Ortho., and RHMS)	Style A1	Each Single Bed
MS&N (Medical, Surgical Neurological, Ortho., and RHMS)	Style A2	Between Each Pair of Beds
RESPIRATORY CARE		
Monitored Beds	Style B1 (90% of total beds in unit)	Each Bed
	Style C (10% of total beds in unit)	Each Bed
SPINAL CORD INJURY UNIT		
Medical Isolation	Style C	Each Bed
Acute/Respiratory Care	Style C	Each Bed
SURGICAL RECOVERY ROOM	Style B1	Each Bed

6.6 MEDICAL GAS, VACUUM, AND AIR ALARM SYSTEMS


- (a) Provide two master alarm signal panels for nonflammable medical gas, medical-surgical vacuum, and laboratory air and laboratory vacuum systems in separate warning locations. Provide master alarm panels at the Telephone Switchboard and Engineering Control Center. If an Engineering Control Center is not provided, install master alarm panels at the Security Office or other suitable continuously staffed location.
- (b) Provide area alarms at Nurse Stations in locations where nonflammable medical gas and medical-surgical vacuum systems are installed.
- (c) NFPA 99 allows one of the two required alarm systems to be computerized. If this option is chosen by the A/E, VA prefers the computerized system to be the HVAC control system, if it is UL-listed for this application. Addressable fire alarm systems shall be permitted to monitor medical gas alarms provided that the alarm signals are programmed as a supervisory signal and do not initiate the building fire alarm system.




APPENDIX A: DRAWINGS

The drawings shown in Appendix A are two possible single-line diagram topologies for normal, Essential Electrical System (EES), and Standby systems. The A/E shall use these topologies as a basis of design for the project.



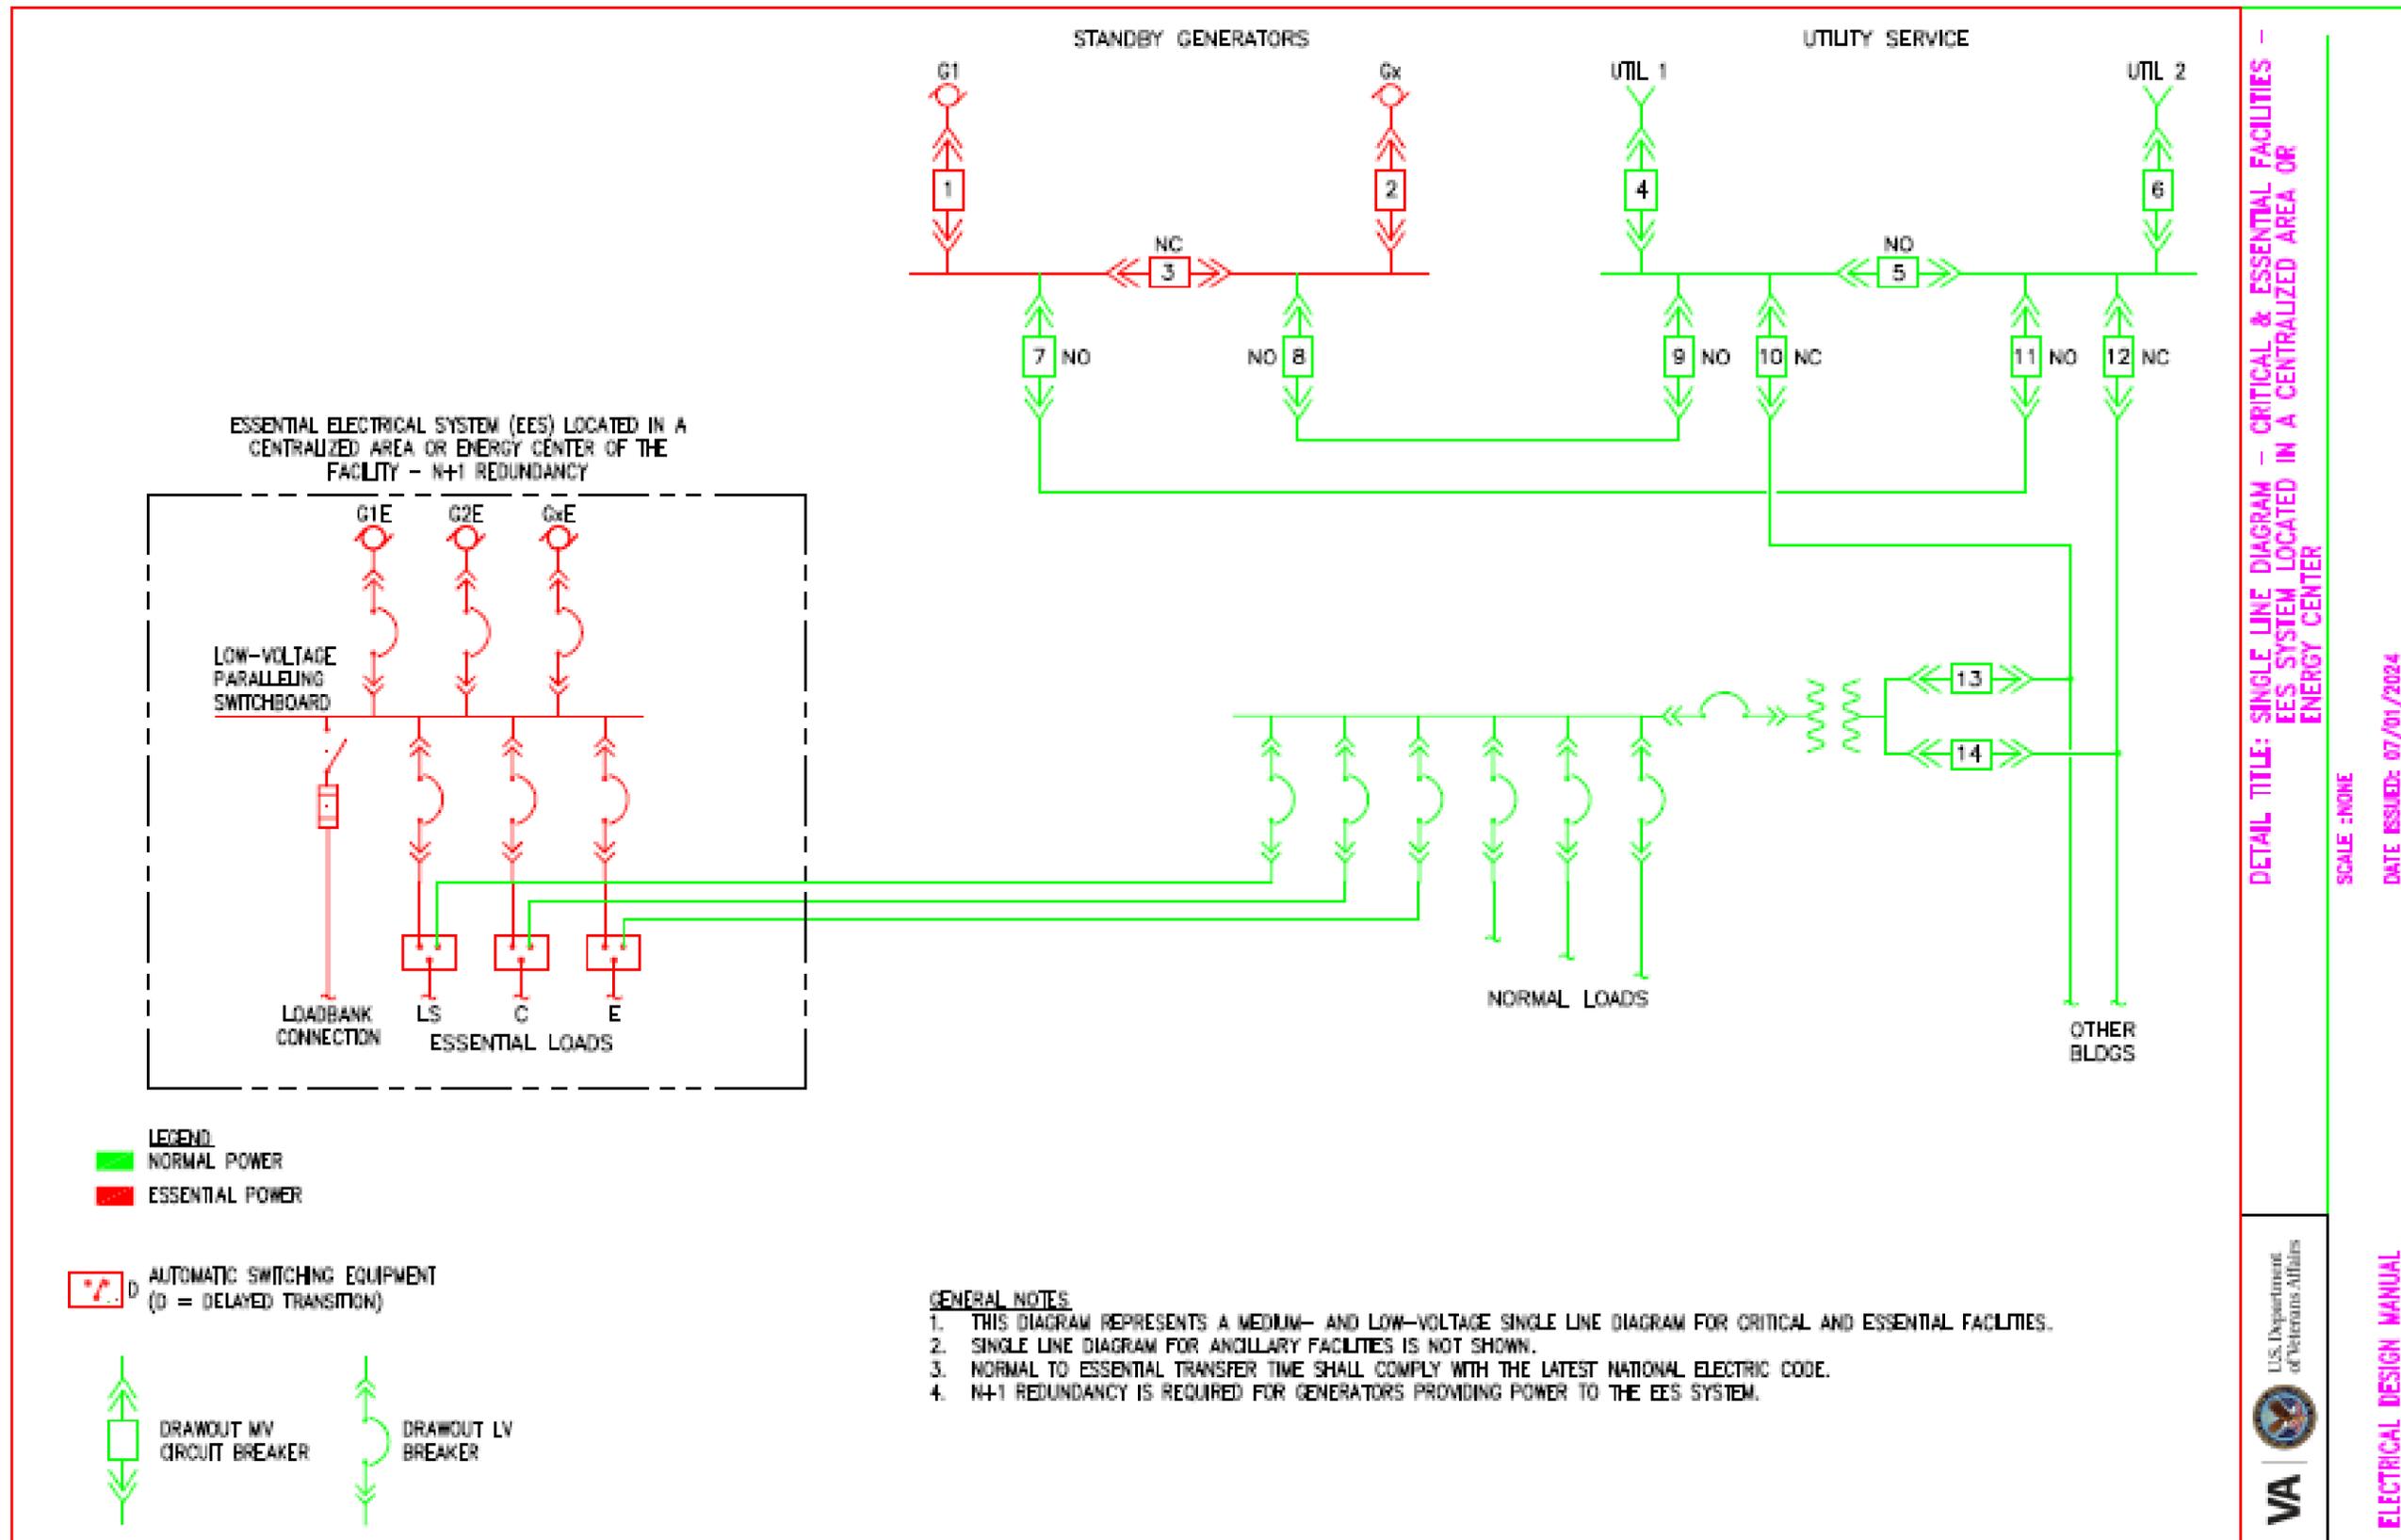

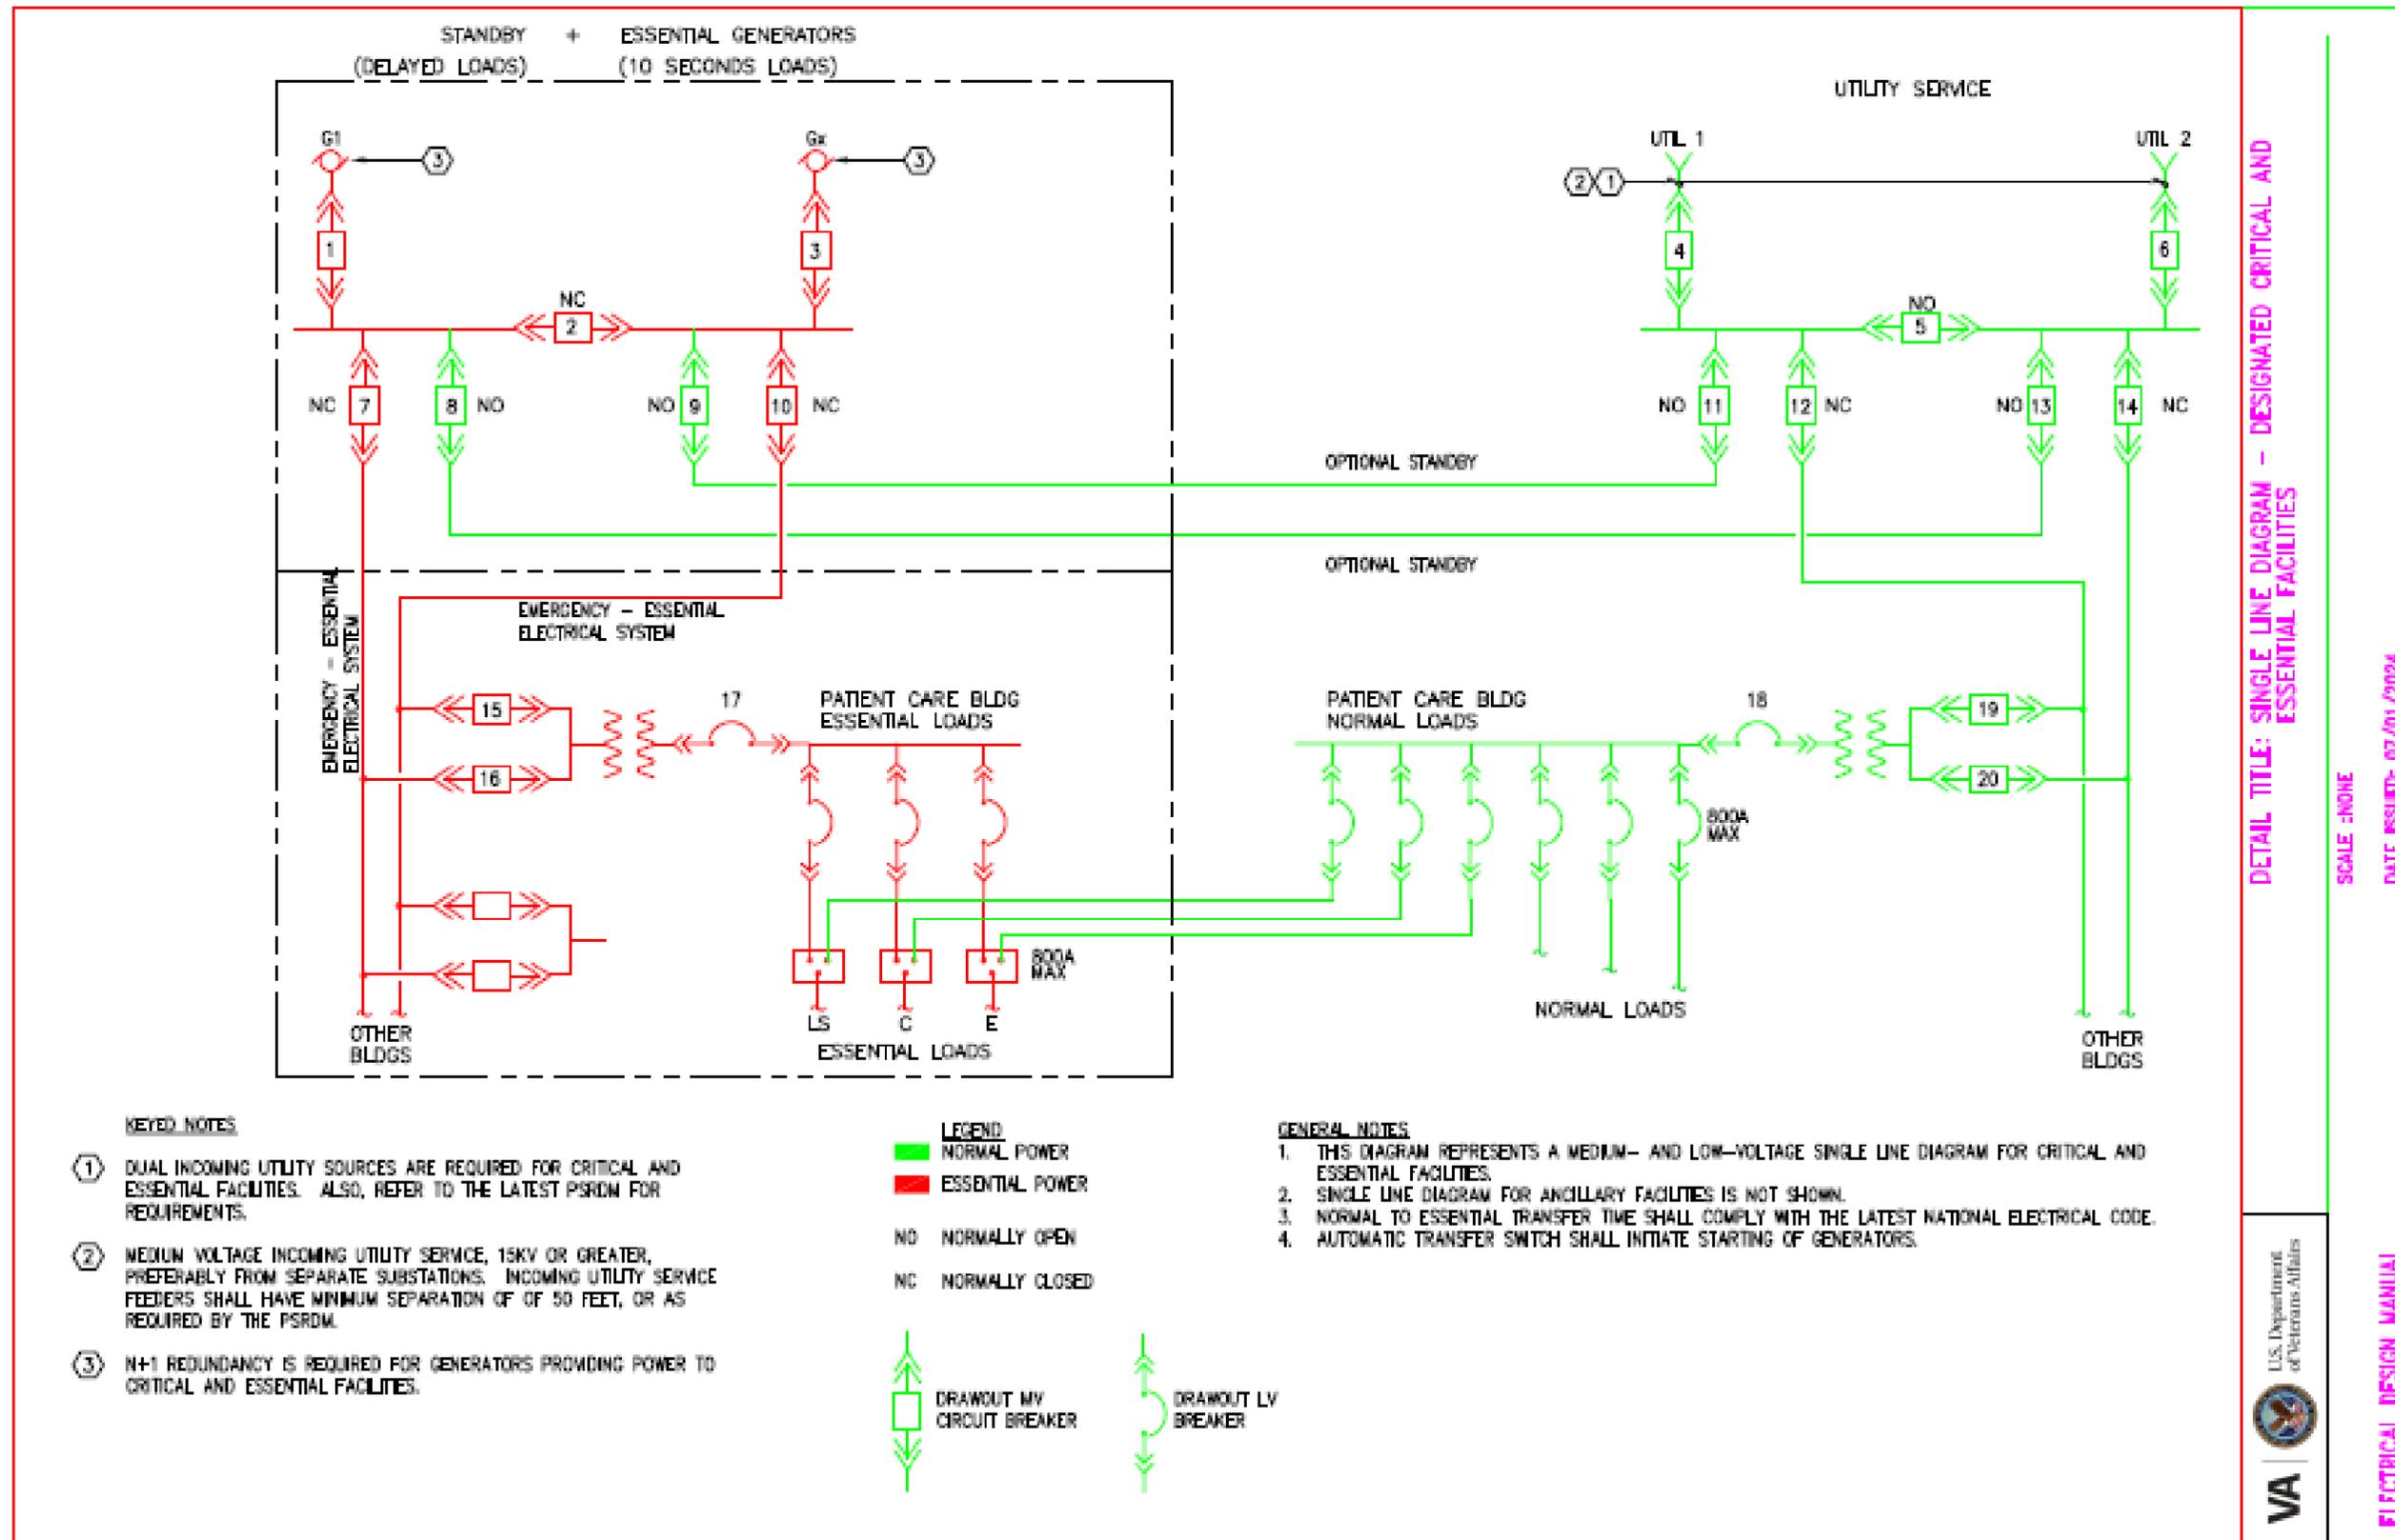

END

(This page intentionally left blank)

