


VA



U.S. Department of Veterans Affairs

Office of Construction & Facilities Management
Office of Facilities Planning
Facilities Standards Service

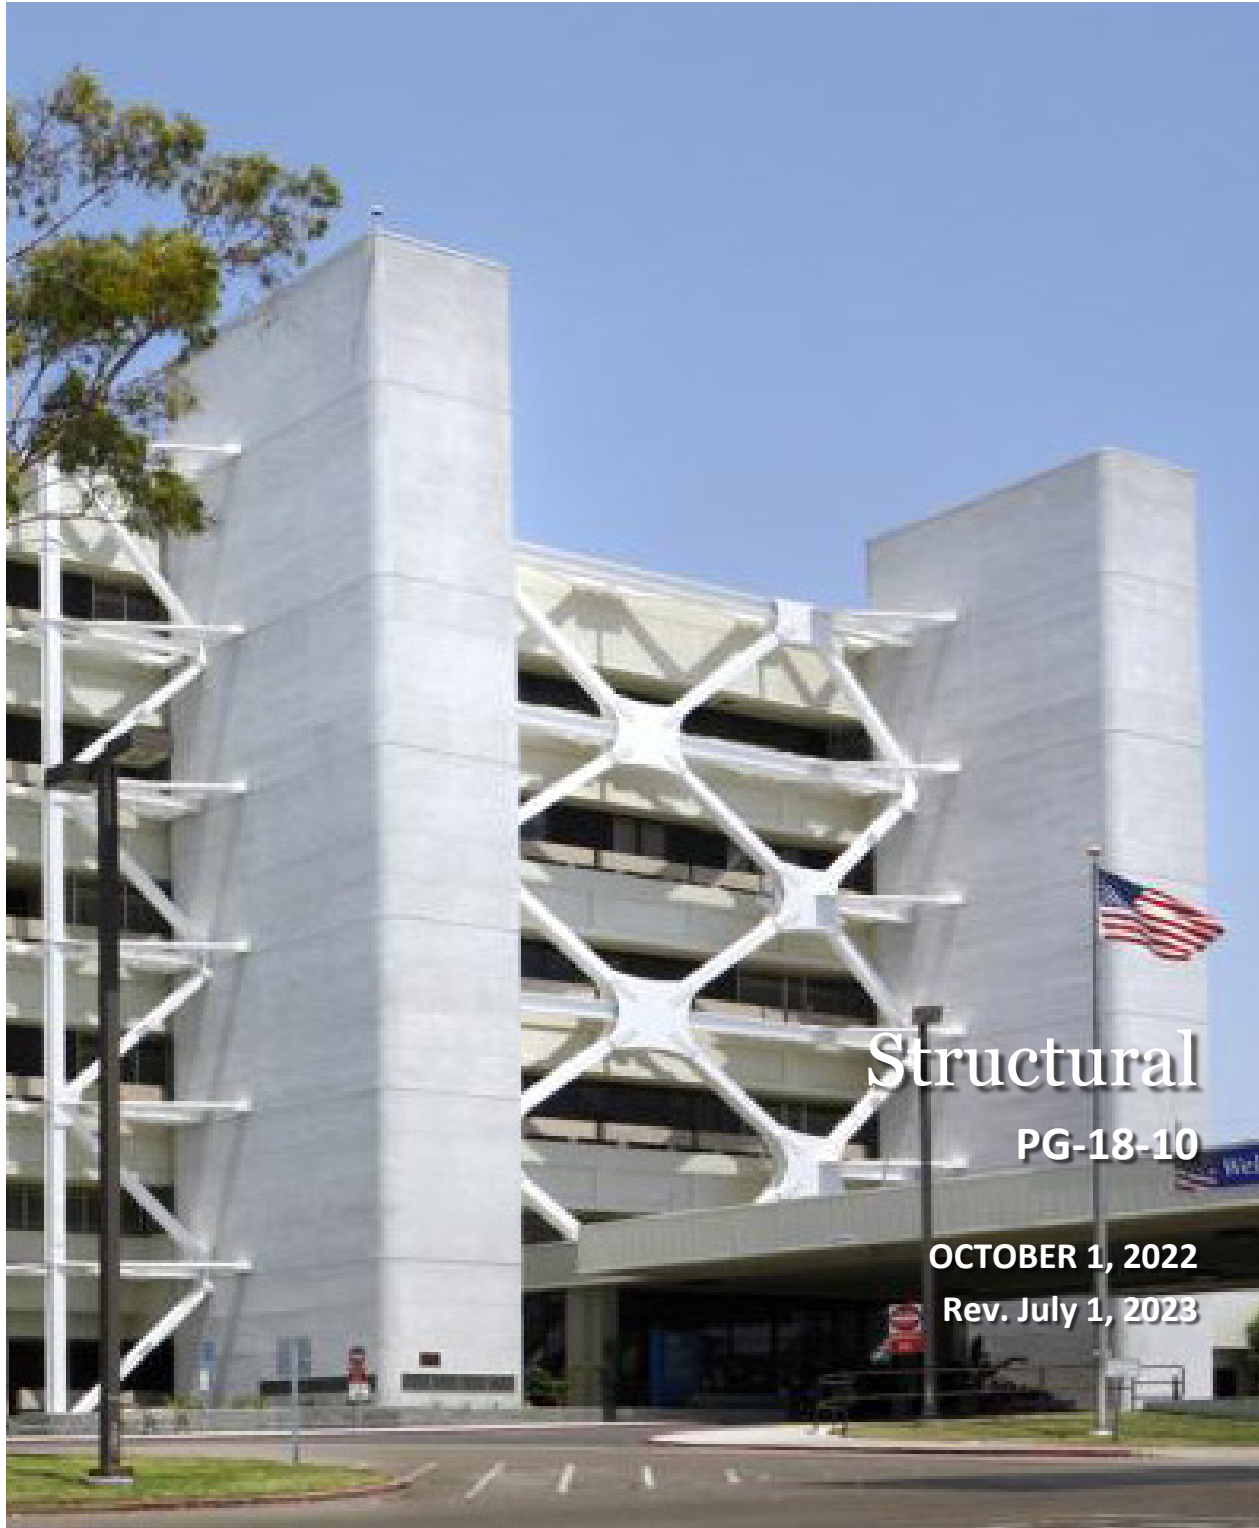

Structural

PG-18-10

OCTOBER 1, 2022

Rev. July 1, 2023

designmanual

TABLE OF CONTENTS

1.0 GENERAL1

2.0 STRUCTURAL DESIGN LOAD REQUIREMENTS.....1

 Table 1 – Minimum Uniformly Distributed Live Loads2

 Table 2 – Special Load Requirements3



1.0 GENERAL

- A. The structural design of all new facilities, new additions, and renovation/retrofit of existing buildings shall comply with the latest editions of the following codes and standards, unless noted otherwise:
 - 1. International Building Code (IBC)
 - 2. ASCE/SEI 7-22, Minimum Design Loads and Associated Criteria for Buildings and Other Structures, American Society of Civil Engineers
 - 3. VA Handbook H-18-8 Seismic Design Requirements
 - 4. VA Physical Security and Resiliency Design Manual (PSRDM)
 - 5. VA Fire Protection Design Manual (for fireproofing requirements of structural elements)
- B. Significant variations from the above in local building codes shall be brought to the attention of VA.
- C. Where there is a conflict between a requirement in the IBC and referenced VA standards in the design handbooks/manuals above, the VA standards shall govern.
- D. The Risk Category for determination of all structural design loads shall be based on the Facility Criticality Designation defined in H-18-8.

2.0 STRUCTURAL DESIGN LOAD REQUIREMENTS

- A. Minimum uniform basic design live loads shall conform to IBC requirements, except as shown in Table 1 and Table 2.
- B. Allowance of 20 psf shall be made for partitions on floors where specified live load is less than 100 psf, in addition to all other loads. Where live loads are 100 psf and greater, specific partition locations may be used for design; however, appropriate notes must be made on the drawings.
- C. Provision shall be made in designing floors for a concentrated load of 2000 lb, placed upon any space 2.5 ft square, wherever this load upon an otherwise unloaded floor would produce stresses greater than those caused by the uniform load. On walk-on ceiling the design concentrated load shall be 300 lb.
- D. In order to provide a flexible design allowing certain range of occupancy changes in the future, generalized live load categories should be applied to large areas preferably one category to any one floor.
- E. Roof live loads shall be based on geographical location and local governing building code requirements; however, they shall not be less than 20 psf.
- F. Where actual occupancy load requirements or concentrated equipment loads distributed over a reasonable area exceed the equivalent generalized uniform live loads, the areas in question shall be designed to meet the specific load conditions.



Refer to Table 2 of selected functional areas with special uniform load requirements and heavy equipment loads that may require special consideration.

- G. For Parking Structures, there shall be no live load reduction for design of horizontal framing members.

Table 1 – Minimum Uniformly Distributed Live Loads ^a

| Occupancy or Use | Live Loads (psf) | Notes |
|---|------------------|---|
| Administrative Services, Office Areas | 80 | - |
| Nursing Homes (Community Living Centers) – All Future Floors (Unless Otherwise Noted) – for bedrooms only | 60 | All non-bed areas of future floors shall be designed for a live load of 100 psf. |
| All Future Floors (Unless Otherwise Noted) – All Others | 100 | - |
| Bedrooms/ward rooms | 40 | - |
| Catwalks/Service Platforms | 40 | - |
| Clinical and Support Services | 80 | - |
| Corridors - In Wards, Nursing Home | 60 | - |
| Corridors - All Others | 100 | - |
| File and Computer Rooms | 125 | - |
| Interstitial Floor (Walk-on Ceilings) | 25 | This load may be reduced to 15 psf in combination with floor live load. |
| Kitchen and Dining Areas | 100 | - |
| Laundries | 200 | Areas occupied by special equipment, such as, Flat-Work Ironer, Monorail, Washer Extractor, etc., shall be designed actual equipment loads. |
| Libraries & Light Storage | 125 | - |
| Loading Docks and Platforms | 250 | - |
| Lobbies | 100 | - |
| Machine Room | 150 | Areas supporting heavy equipment shall be designed for the actual operating weight of such equipment. |
| Mechanical Rooms | 150 | - |

^a Design Live Loads shall be noted on the drawings in the general notes and on plans to indicate specific areas designated for different loads. Column design loads shall be noted in column schedules.



| Occupancy or Use | Live Loads (psf) | Notes |
|----------------------------------|------------------|-------|
| Pharmacy | 100 | - |
| Retail | 100 | - |
| Recreation Areas | 100 | - |
| Research and Education Buildings | 100 | - |

Table 2 – Special Load Requirements

| Functional Departments | Special Areas Uniform Load | Loads (psf) | Special Equipment Loads |
|------------------------|---|-------------|--|
| Dietetic Service | Refrigeration & Frozen Storage | 200 | Baking Oven, Cooking Oven, Refrigerators, Ice-making Machines, Dishwashers |
| Engineering Service | Maintenance & Repair Shops | 150 | - |
| Laboratory Service | Morgue | 150 | - |
| Laundry | Washers/Dryers | 200 | Flat Work Ironer Monorail, Washer-Extractor |
| Medical Research | Gas Cylinder Storage | 250 | Mechanical Cage Washer, Concrete Dog Cages |
| Radiology Service | X-Ray Film Storage, Stationary Files | 250 | Radiographic & Fluoroscope Equip, Tomograph Table Cobalt 60 Units, Linear Accelerators, Overhead Equipment |
| Radiology Service | Mobile (Rolling) | 400 | Radiographic & Fluoroscope Equip, Tomograph Table Cobalt 60 Units, Linear Accelerators, Overhead Equipment |
| Supply Service | Light Storage | 150 | Automatic Cart Washer, Heavy Sterilizer, Storage Tank, Vaults |
| Supply Service | Heavy Storage/Warehouse | 250 | Automatic Cart Washer, Heavy Sterilizer, Storage Tank, Vaults |
| Supply Service | Loading Dock | 250 | Automatic Cart Washer, Heavy Sterilizer, Storage Tank, Vaults |
| Miscellaneous Services | Mobile (Rolling) Storage & Record Files | 300 | - |

