


FAN COIL SEQUENCE OF OPERATION (COOLING ONLY)

1. FAN COIL UNIT SHALL OPERATE ON A SCHEDULE AS SET BY THE DCC.
2. MODULATE V-1 TO MAINTAIN SPACE SET POINT AND FAN SHALL CYCLE W/TEMPERATURE.
3. ALARM IF SPACE TEMPERATURE OUTSIDE OF RANGES.

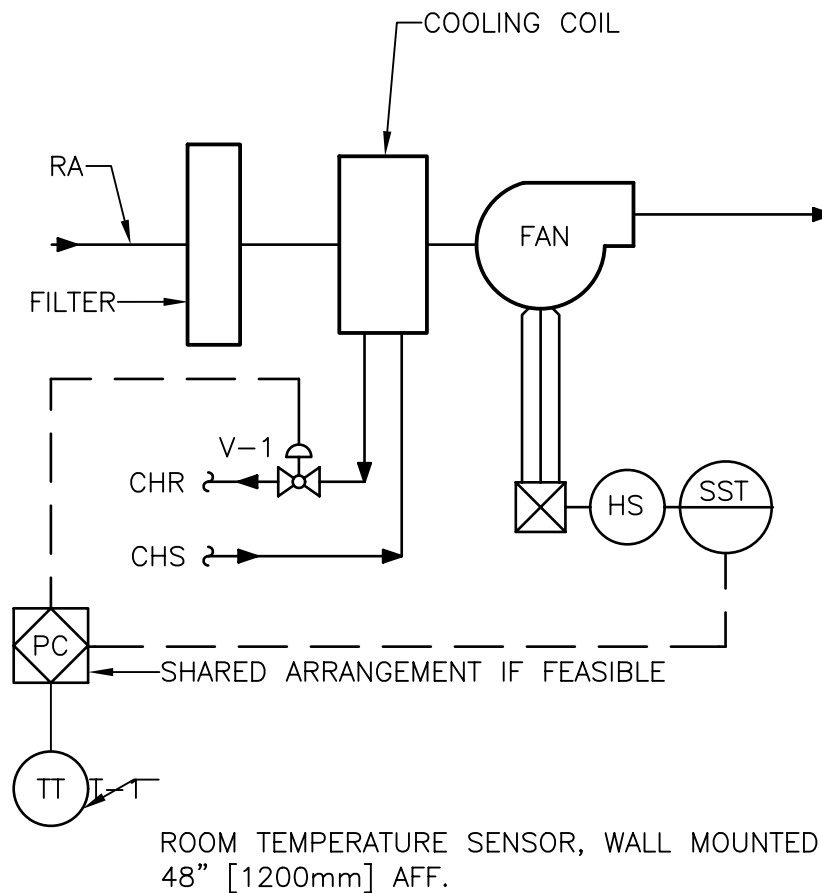

COOLING ONLY FAN COIL UNIT CONTROLS

NTS
DESIGNER'S NOTE

1. MODIFY THE DETAIL IF DCC IS NOT USED.



Department of
Veterans Affairs

DETAIL TITLE / COOLING ONLY FAN COIL UNIT CONTROLS

SCALE :NONE

DATE ISSUED : DECEMBER 2008

CADD DETAIL NO. : SD238200-01.DWG