



PIPING CONNECTIONS TO HORIZONTAL TYPE STEAM UNIT HEATER

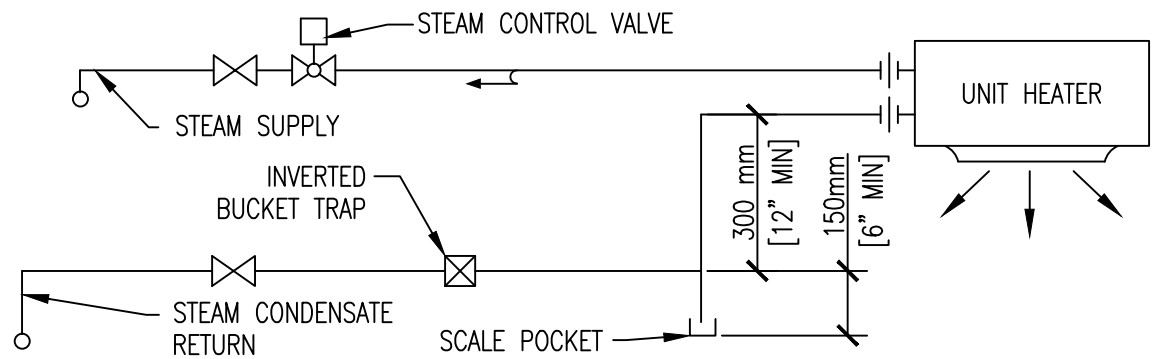

PIPING CONNECTIONS TO VERTICAL TYPE STEAM UNIT HEATER

NOTE:
 UNIT MOUNTED THERMOSTAT SHALL MAINTAIN SPACE TEMPERATURE
 AS INDICATED IN CONTROL SEQUENCE OR HVAC CONTROL DRAWINGS.

UNIT HEATERS (STEAM) PIPING CONNECTIONS



NTS



Department of
 Veterans Affairs

DETAIL TITLE: UNIT HEATERS (STEAM)
 PIPING CONNECTIONS

SCALE :NONE

DATE ISSUED: 11/01/2017

CAD DETAIL NO.: SD238200-07.DWG